

# PowerLogic™ P1

Catalog 2024  
Network Protection Relays



[se.com/PowerLogic](https://se.com/PowerLogic)

Life Is On

**Schneider**  
Electric

Note: Electrical power systems are dangerous, protection relays are defined and governed by international standards such as IEC 60255 “Measuring relays and protective equipment” and IEEE C37.97 “Protective relay applications to power systems buses”. Never attempt to install or operate protection relays or associated equipment without the necessary qualifications, training and tools.

# General Contents



Range Description	4
Product Description	12
Digital Experience	50
Services	54
Ordering	58

# PowerLogic™ P1

## Range Description

# PowerLogic™ P1 Range Description

Overview	8
Selection Guide	9
Selection Guide by Protection Functions	9
Selection Guide by Technical Characteristics	10
Communication	11

# Take PowerLogic™ Protection Relays Further with EcoStruxure™

EcoStruxure, Schneider Electric's IoT-enabled, open and interoperable architecture and platform, brings together Connected Products, Edge Control, and Apps, Analytics & Services. EcoStruxure connected products deliver enhanced value around safety, reliability, efficiency, sustainability, and connectivity.

## 450000

EcoStruxure systems deployed since 2007 with the support of our 9,000 system integrators

## EcoStruxure ready




**Efficient asset management**  
Help boost your efficiency and participate to reduce downtime using predictive maintenance tools



**24/7 connectivity**  
Make better informed decisions with real-time data that's available everywhere, anytime



**Enhanced safety**  
Advanced features designed-in based on well-known designs, experience and technology

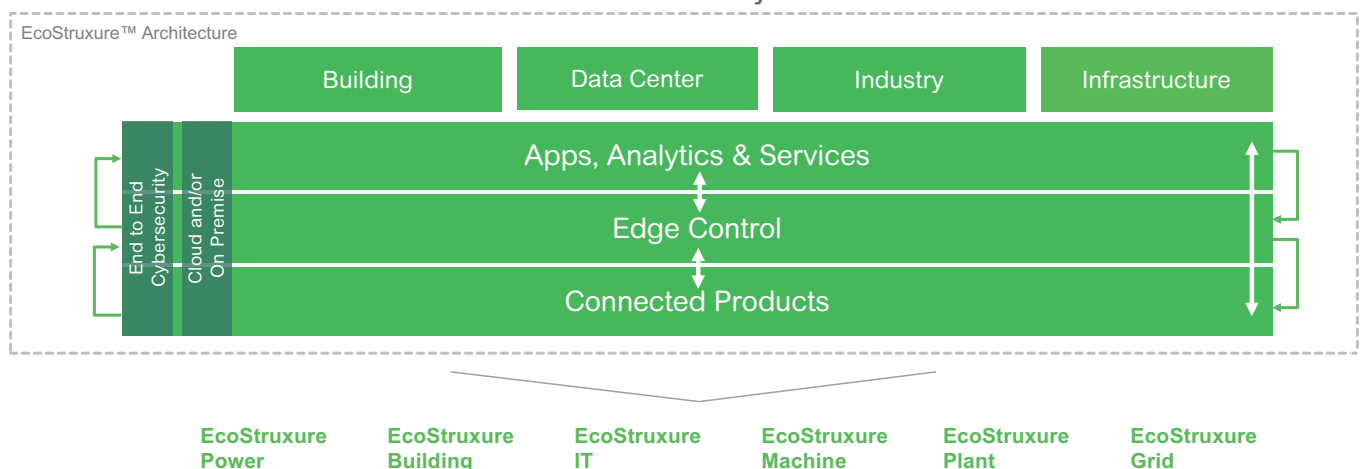



# PowerLogic™ P1 at a Glance

Built on over a century of experience in medium-voltage protection relays, the new PowerLogic P1 is designed to meet your customers' needs for electrical protection, connectivity and everyday ease-of-use.

PowerLogic P1 is designed to be an effective solution for simple applications like overcurrent, earth-fault, voltage and frequency, working with traditional CTs or LPCTs. Suited for basic distribution applications in commercial and industrial buildings, industrial settings or distribution utilities or as LV applications when ANSI functions are required. Ideal for back-up protection in new installations or in retrofit applications when replacing legacy relays. Reduce time and costs with simple installation, setting and configuration.

Get more benefits with digital, reliable and efficient PowerLogic P1:

- Single function voltage or current protection
- Incomer, feeder or transformer applications
- Simple to order, install and operate



Simple, reliable,  
and easy-to-use  
protection relays



ANSI or IEC

Ideal for industrial buildings, distribution utilities and LV applications  
(if ANSI functions are needed)




CE markings as per Directive 93/98/CEE

ISO/EHS/OHSAS certified manufacturing facility reinforces product quality and reliability. Independent lab reports available for CE.



Features and options		
Current	3CTs or LPCTs + 1CT	–
Voltage	1VT (option)	3VT or 4VT*
Overcurrent protection	✓	–
Directional earth-fault protection	✓*	–
Voltage protection	–	✓
Frequency protection	–	✓*
Inputs	up to 8	up to 6
Outputs	up to 7 + WD	up to 7 + WD
Programmable LEDs	6	6
CB control keys	✓	✓
Communications	USB* & RS485*	USB* & RS485*
Records	✓*	✓*
Display	LCD 32 x 2	LCD 32 x 2

\* Depending on the model

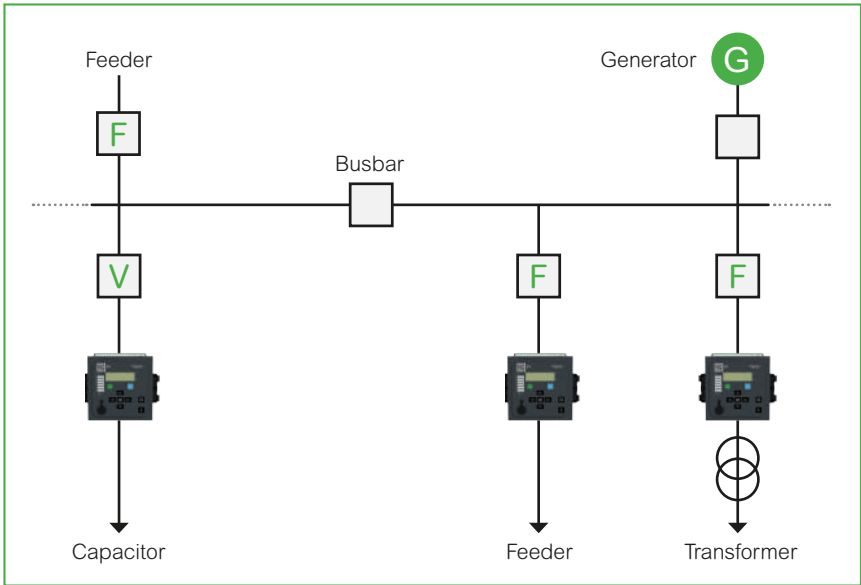



# Selection Guide

## by Protection Functions


		PowerLogic P1F							PowerLogic P1V		
Protection functions	ANSI code	P1F1L	P1F1L+	P1F1N	P1F1B	P1F1A	P1F1E,C,T	P1F1E+,C+,T	P1V1L	P1V1N	P1V1A
Phase overcurrent	50/51	3	3	3	3	3	3	3	-	-	-
Earth fault overcurrent	50N/51N	2	2	2	2	2	3	3	-	-	-
Negative sequence overcurrent	46	-	-	-	-	-	1	1	-	-	-
Cur. unbalance, broken conductor	46BC	-	-	-	-	-	1	1	-	-	-
Thermal overload	49	-	-	1	1	1	1	1	-	-	-
Breaker failure	50BF	1	1	1	1	1	1	1	-	-	-
Switch On To Fault (SOTF)	50HS	-	-	-	1	1	1	1	-	-	-
Directional earth-fault o/c	67N/21Y*	-	-	-	-	-	-	2	-	-	-
Magnetizing inrush detection	68F2	-	-	-	-	1	1	1	-	-	-
Auto-recloser based on current	79	-	-	-	-	-	4	4	-	-	-
Overvoltage	59	-	-	-	-	-	-	-	3	3	3
Undervoltage	27	-	-	-	-	-	-	-	3	3	3
Positive sequence undervoltage	27P	-	-	-	-	-	-	-	-	-	2
Negative sequence overvoltage	47	-	-	-	-	-	-	-	-	2	2
Neutral voltage displacement	59N	-	-	-	-	-	-	-	-	3	3
Derived Vo sequence overvoltage	59N	-	-	-	-	-	-	-	3	3	3
VT supervision	60FL	-	-	-	-	-	-	-	-	1	1
Auto-recloser based on Frequency	79V	-	-	-	-	-	-	-	-	-	1
Over or under frequency	81	-	-	-	-	-	-	-	-	-	6
Rate of change of frequency (RoCoF)	81R	-	-	-	-	-	-	-	-	-	1
Lockout	86	1	1	1	1	1	1	1	1	1	1
Cold load pick-up		1	1	1	1	1	1	1	-	-	-
Blocking logic		-	-	-	1	1	1	1	-	1	1
IDMT curves		21	21	21	21	21	21	21	15	15	15
Setting groups		2	2	2	2	2	2	2	2	2	2
Auxiliary timers		-	-	-	4	4	4	4	-	3	3

\* E/F Protection can be set as directional E/F protection or admittance protection

# Selection Guide

by Characteristics

PowerLogic P1F										PowerLogic P1V		
Hardware	P1F1L	P1F1L+	P1F1N	P1F1B	P1F1A	P1F1E,C	P1F1E+,C+	P1F1T	P1F1T+	P1V1L	P1V1N	P1V1A
Phase current inputs - Conventional CTs	3	3	3	3	3	3	3	-	-	-	-	-
Phase current inputs - LPCT	-	-	-	-	-	-	-	3	3	-	-	-
Residual current inputs	1	1	1	1	1	1	1	1	1	-	-	-
Phase voltage inputs	-	-	-	-	-	-	-	-	-	3	3	3
Neutral voltage inputs	-	-	-	-	-	-	1	-	1	-	1	1
Digital inputs	-	-	-	4	4	8	8	8	8	-	2	6
Digital outputs	3+WD	3+WD	5+WD	3+WD	7+WD	5+WD	5+WD	5+WD	5+WD	3+WD	5+WD	7+WD
USB front port with powering	-	-	1	1	1	1	1	1	1	-	1	1
RS485 rear port	-	1	1	1	1	1	1	1	1	-	1	1
Control functions												
Local/remote function	-	●	●	●	●	●	●	●	●	-	●	●
Local control with I/O keys	●	●	●	●	●	●	●	●	●	●	●	●
Remote control with RS485	-	●	●	●	●	●	●	●	●	-	●	●
Remote control with digital inputs	-	-	-	●	●	●	●	●	●	-	-	●
Time Synchronization with digital input	-	-	-	-	-	●	●	●	●	-	-	●
Auxiliary timers	-	-	-	4	4	4	4	4	4	-	3	3
Measurement												
RMS current values	●	●	●	●	●	●	●	●	●	-	-	-
RMS voltage values	-	-	-	-	-	-	-	-	-	●	●	●
Frequency	-	-	-	-	-	-	-	-	-	-	-	●
Positive sequence of voltage	-	-	-	-	-	-	-	-	-	-	-	●
Negative sequence of voltage	-	-	-	-	-	-	-	-	-	-	●	●
Thermal overload	-	-	●	●	●	●	●	●	●	-	-	-
Inrush current ratio	-	-	-	-	●	●	●	●	●	-	-	-
Positive sequence of current IS1	-	-	-	-	-	●	●	●	●	-	-	-
Negative sequence of current IS2	-	-	-	-	-	●	●	●	●	-	-	-
Relative IS2/IS1	-	-	-	-	-	●	●	●	●	-	-	-
Phase Peak Demand Current Values	●	●	●	●	●	●	●	●	●	-	-	-
Logs and Records												
Tripping context record	20	20	20	20	20	20	20	20	20	20	20	20
Sequence of event record	-	200	200	200	200	200	200	200	200	-	200	200
Disturbance record	-	-	-	-	4 s	4 s	4 s	4 s	4 s	-	-	4 s
Monitoring functions												
Trip circuit supervision	-	-	-	-	1	1	1	1	1	-	-	-
Circuit breaker monitoring & diagnostics	-	-	-	-	1	1	1	1	1	-	-	1
Counters	-	-	-	-	1	1	1	1	1	-	-	1
Self-supervision (WD)	●	●	●	●	●	●	●	●	●	●	●	●

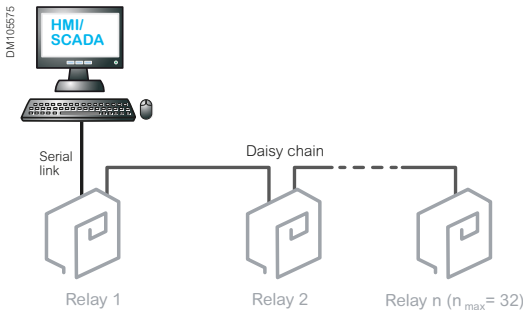

Connection to SCADA using Serial Line

This architecture allows you to connect HMI/SCADA to a set of PowerLogic protection relays using a multi-drop serial communication link with client-server communication.

Available protocols: Time synchronization protocol:

- Modbus RTU
- IEC 60870-5-103
- Minute pulse


Connection to SCADA using serial lines and legacy protocols

This architecture allows you to connect HMI/SCADA to a set of PowerLogic protection relays using a multi-drop serial communication link with client-server communication protocols such as Modbus-RTU or IEC 61870-5-103.

The RS485 serial communication port of the PowerLogic protection relay enables simple daisy chaining suited for 2-wire. A termination module is plugged into the last connection.

Data Exchanged Between  
PowerLogic™ P1F/P1V and SCADA

Protocol	Modbus	IEC 60870-5-103
Real time data		
Measurement	•	•
Alarms and status	•	•
Controls	•	•
Time-stamped events	•	•
Historical data		
Disturbance records	•	-
Sequence of event record files	•	-
Setting management		
Setting group change	•	•
Settings	•	-

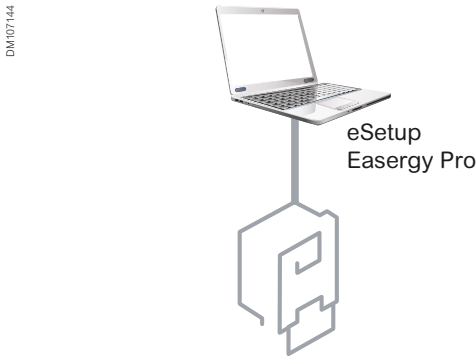

Engineering System

eSetup Easergy Pro

eSetup Easergy Pro (or PowerLogic Studio) can be connected to a single PowerLogic protection relay on the front USB port.

eSetup Easergy Set allows you to prepare the configuration of the relay without having any physical relay. For this purpose, eSetup Easergy Pro provides the latest version of the configuration description file directly from the web.

# PowerLogic™ P1

## Product Description

# PowerLogic™ P1

## Product Description

<b>PowerLogic™ P1 Presentation</b>	<b>14</b>
<b>PowerLogic™ P1F Description</b>	<b>15</b>
General Overview	15
Functional View	16
Protection Function Overview	17
Protection Function Setting Ranges	18
Control and Monitoring Function Setting Ranges	27
Disturbance Records Setting Ranges	28
<b>PowerLogic™ P1V Description</b>	<b>29</b>
General Overview	29
Functional View	30
Protection Function Overview	31
Protection Function Setting Ranges	32
Command and Control Functions	37
<b>Base Unit Description</b>	<b>39</b>
Local HMI	39
Front and Rear Panel Connections	40
<b>Base Unit Dimensions</b>	<b>41</b>
Dimensions	41
Cut-Out and Mounting	41
<b>Base Unit Characteristics</b>	<b>42</b>
Environmental Characteristics	42
<b>Ratings</b>	<b>43</b>
Power Supply and Nominal Burden	43
Current and Voltage Inputs	44
Frequency and Current Inputs	45
Output Relay Characteristics	46
<b>Connection Diagram</b>	<b>47</b>
PowerLogic™ P1V	47
PowerLogic™ P1F	48

The PowerLogic P1 relays are suitable for the applications where overcurrent and/or earth-fault and voltage protection are required.

PowerLogic P1F and P1V models can be applied to medium and low voltage electrical systems.

PowerLogic relays provide features for easy adaptation to different applications and operation conditions. The P1F and P1V models can be fully configured manually, without using setting software.

Alternatively, eSetup Easergy Pro (or PowerLogic Studio) setting software allows configuration parameters to be modified for a specific application via the USB port.

IEC 60870-5-103 and Modbus RTU integrated communication protocols are available for flexible integration into most substation control or DCS systems.

Close and trip commands can be executed via functional key on the front panel, default menu window, DCS/SCADA system (RS485) or configured binary input. Simpler operation and maintenance with the EcoStruxure™ Power

Three level password gives proper access rights for secure maintenance of the relay.

As a device housed in a small sized flush-mountable case, the P1V and P1F models can be easily installed in all modern, dimension-focused switchgear panels, up to IP54 ingress protection degree.

The relay can be also considered as a cost-effective answer to retrofit demands of older substations.

In P1F we have, for overcurrent protection functionality, selectable measuring criteria: True RMS and/or fundamental frequency (Fourier) current measurements allow to increase selectivity and adapt to the application.





### Customer benefits

**Easy to use**

Easy to use with EcoStruxure™ Power Operation  
Help to economize your time and money

**Flexible**

Help to optimize your investment

**Reliable**

Help to reduce risk and power outage  
Strive for sustainability

## Main Features

The following functions are generally available in all devices:

- Operate in 1, 2, or 3-phase arrangement.
- Two setting groups, selected from the relay menu, binary input or SCADA/DCS.
- Flush mounted case.
- Fundamental and True RMS (within a frequency range from 10Hz to 1kHz) phase current value measurement.
- 9 button keypad to input settings, configure the relay and close and trip command and display (graphical).
- Fault record for most recent trips.

The P1F protection relays are comprised of a suite of protection functions as well as auxiliaries. Each function can be individually configured or disabled to suit every kind of application.

All available functions, including protection, automation, communication, LEDs, inputs and outputs, are easily programmable through the user-friendly human machine interface and/or the eSetup Easergy Pro software interface.

The graphical LCD provides the user with key information (faults, measurements, settings, etc.). The menus have a pull-down structure for easy use and quick access to any data. User can switch HMI language directly through the front panel.

8 LEDs (6 freely configurable) indicate the correct operation of the relay as well as other information regarding the protection of the electrical system.

The hardware architecture and software algorithms have been designed to operate on very short failure detection times. Tripping occurs typically within 40 ms.

Easy to use with EcoStruxure™ Power Operation.


## Application

PowerLogic P1F numerical overcurrent protection relay provides an optimized solution. Typical applications are:

- Utility and industrial substation fitted with cost-optimized MV switchboards
- Retrofit relays of old technology, particularly during installation of DCS systems
- Transformers, incomers, bus couplers, overhead lines and underground cables on MV systems
- Neutral system protection (insulated, solid and resistance earthed)
- LV substations.



DE446477

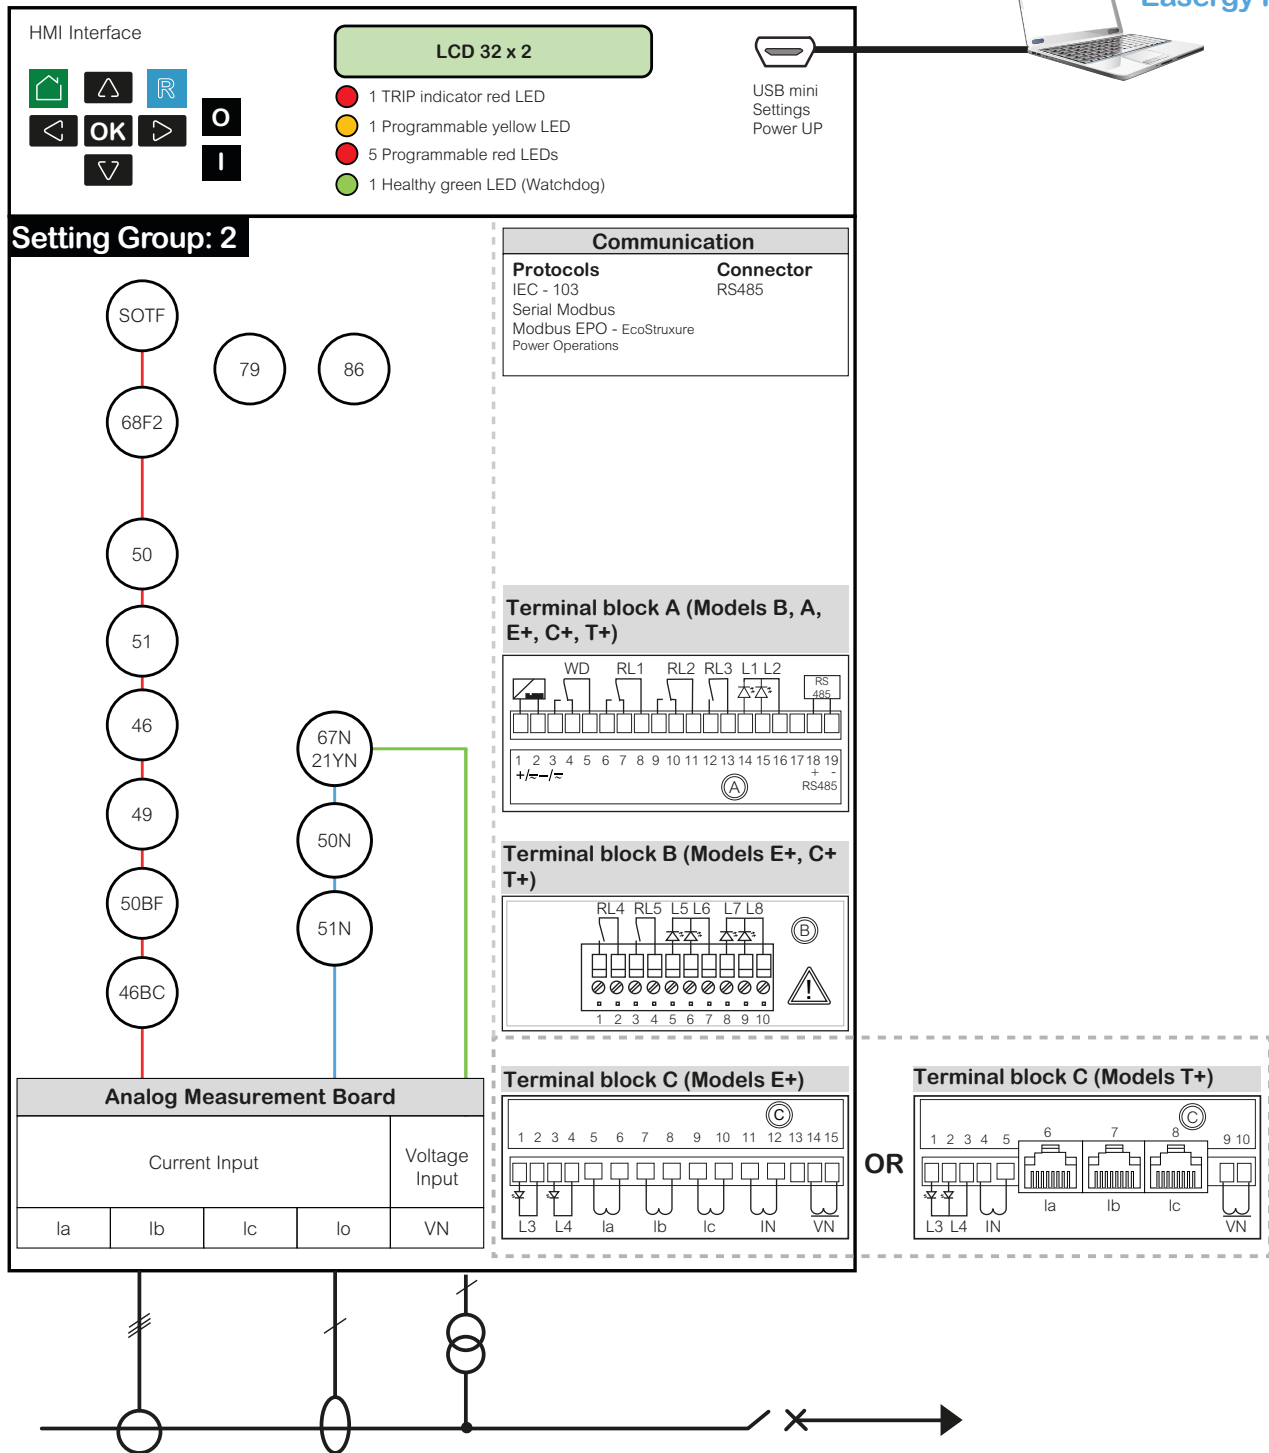

eSetup  
Easergy Pro

# PowerLogic™ P1F Description

## Protection Functions Overview

IEEE device no.	PowerLogic™ P1F functions	Model L & L+	Model N	Model B	Model A	Model E,C,T	Model E+,C+,T+
49	Thermal overload (true RMS) 2 independent thresholds (Alarm, Trip)		•	•	•	•	•
50BF	Circuit breaker failure	•	•	•	•	•	•
50/51	Three-phase non directional overcurrent 3 independent thresholds (21 groups of IDMT curves)	•	•	•	•	•	•
	Switch on to fault (SOTF)			•	•	•	•
	Inrush blocking (2nd harmonic)				•	•	•
	Selective relay scheme logic					•	•
	Blocking logic			•	•	•	•
	Cold Load Pick-Up	•	•	•	•	•	•
50N/51N	Phase-earth non directional overcurrent 2 independent thresholds (21 groups of IDMT curves)	•	•	•	•	•	•
67N/21Y <sup>(1)</sup>	Directional earth-fault protection (2 stages)						•
46	Negative phase sequence overcurrent					•	•
46BC	Broken conductor detection (I2 / I1)					•	•
79	Auto reclose (4 shots)					•	•
86	Output relay latching	•	•	•	•	•	•
	Binary inputs	0	0	4	4	8	8
	Output relays	3	5	3	7	5	5
	Watchdog contact	1	1	1	1	1	1
	Phase current inputs (0.1-40 In)	3	3	3	3	3	3
	Neutral current input (0.01-2 IN or 0.05-12 IN)	1	1	1	1	1	1
	Neutral voltage input (5-130V)						1
	Circuit breaker supervision				•	•	•
	Trip circuit supervision				•	•	•
	Event recording	• <sup>(2)</sup>	200	200	200	200	200
	Fault recording	20	20	20	20	20	20
	Disturbance recording				4 s	4 s	3 s
	CB condition monitoring and Counters				•	•	•
	Setting groups	2	2	2	2	2	2
	Time synchronization (via binary input)					•	•
	LCD display	back-lit	back-lit	back-lit	back-lit	back-lit	back-lit
	Mini-USB front port		•	•	•	•	•
	Powering thru mini-USB front port		•	•	•	•	•
	Remote communication (RS485)	• <sup>(2)</sup>	Modbus / IEC103	Modbus / IEC103	Modbus / IEC103	Modbus / IEC103	Modbus / IEC103
	Measurements	•	•	•	•	•	•
	CB control via front keys / RS485 / Binary input	• / - / -	• / - / -	• / • / •	• / • / •	• / • / •	• / • / •

(1) E/F Protection can be set as directional E/F protection or admittance protection

(2) If the relay is equipped with RS485

### Thermal Overload (49)

The protection of transformers and cables must consider their particular thermal characteristics.

PowerLogic P1F relays include a thermal replica element based on the true RMS value of the current, up to the 10th harmonic. Alarm and Trip overload thresholds and time constant are programmable to match application requirement.

Functions	Setting range		
	min.	max.	Steps
<b>[49] Thermal overload (Models N, B, A, E and E+)</b>			
Therm. OL ?	Disabled, Enabled		
Itherm	0.1 In	3.0 In	0.01 In
Te (heating)	1 mn	200 mn	1 mn
Tr (cooling)	1 mn	999 mn	1 mn
Theta Trip	50%	200%	1%
Theta Reset Ratio	20%	99%	1%
Theta Alarm ?	Disabled, Enabled		
Theta Alarm	20%	200%	1%

### Circuit Breaker Failure (50BF)

The circuit breaker failure protection function verifies the effective opening of the CB using a dedicated undercurrent threshold.

The circuit breaker failure function can be activated by the trip of an internal protection function and/or an external command through the relevant digital input. The circuit breaker failure protection function can also be used to trip upstream circuit breakers.

Functions	Setting range		
	min.	max.	Steps
<b>[50BF] Circuit breaker failure</b>			
CB Fail ?	Disabled, Retrip, Alarm		
CB Fail Time tBF	0.1 s	10 s	0.01 s
I< CBF	0.1 In	2 In	0.01 In
<b>High sensitivity current setting</b>			
<b>(0.01-2Ien)</b>			
IN< CBF	0.1 Ien	2 Ien	0.01 Ien
<b>Low sensitivity current setting</b>			
<b>(0.05-12Ien)</b>			
IN< CBF	0.1 Ien	2 Ien	0.01 Ien

### Three-Phase Overcurrent (50/51) & Earth Fault Overcurrent (50N/51N)

Three independent stages are available both for phase and earth fault protection. For the first and second (50/51 only) stages the user may independently select a definite time delay (DMT) or an inverse time delay (IDMT) with different types of curves (IEC, IEEE, RI, RECT, RXIDG, BNP EDF).

Each stage and related time-delay can be programmed to provide adjust selectivity.

The IDMT stages have a selectable reset feature: DMT (0 to 600 s) or an IDMT timer so as to reduce clearance times when intermittent faults occur.

The PowerLogic P1 relays have separate instantaneous and delayed indications for each stage and output relays and LEDs can be configured to indicate the faulted phase(s).

Each protection stage can be disabled, configured to trip a circuit-breaker or to issue an ALARM signal only.

Functions	Setting range		
	min.	max.	Steps
<b>[50/51] Phase overcurrent</b>			
I> ?	Disabled, Trip, Alarm Trip-Inrush BI (A, E, C, T, E+, C+, T+) Trip-Latch (A, E, C, T, E+, C+, T+) Trip-Phase A (A, E, C, T, E+, C+, T+) Trip-Phase B (A, E, C, T, E+, C+, T+) Trip-Phase C (A, E, C, T, E+, C+, T+)		
I>	0.1 In	4 In (IDMT) 40 In (DMT)	0.01 In
Delay type	DMT, IEC SI, IEC VI, IEC EI, LTI, STI, RC, RI, IEEE MI, IEEE VI, IEEE EI, US CO2-P20, US CO8, RXIDG, BNP, EDF, US CO2-P40, US CO5, US CO6, US CO7, US CO9, US CO11, HV_Fuse		
tl>	0.05 s	200 s	0.01 s
I> TMS	0.02	1.50	0.01
I> TD	0.02	100	0.01
I> Reset Delay Type	DT or IDMT		
DT I> tReset	0.00 s	600 s	0.01 s
K (RI)	0.1	10	0.1
I>> ?	Disabled, Trip, Alarm Trip-Inrush BI (A, E, C, T, E+, C+, T+) Trip-Latch (A, E, C, T, E+, C+, T+) Trip-Phase A (A, E, C, T, E+, C+, T+) Trip-Phase B (A, E, C, T, E+, C+, T+) Trip-Phase C (A, E, C, T, E+, C+, T+)		
I>>	0.1 In	4 In (IDMT) 40 In (DMT)	0.01 In
Delay type	DMT, IEC SI, IEC VI, IEC EI, LTI, STI, RC, RI, IEEE MI, IEEE VI, IEEE EI, US CO2-P20, US CO8, RXIDG, BNP EDF, US CO2-P40, US CO5, US CO6, US CO7, US CO9, US CO11, HV_Fuse		
tl>>	0.05 s	200 s	0.01 s
I>> TMS	0.02	1.50	0.01
I>> TD	0.02	100	0.01
I>> Reset Delay Type	DT or IDMT		
DT I>> tReset	0.00 s	600 s	0.01 s
K (RI)	0.1	10	0.01
I>>> ?	Disabled, Trip, Alarm Trip-Inrush BI (A, E, C, T, E+, C+, T+) Trip-Latch (A, E, C, T, E+, C+, T+) Trip-Phase A (A, E, C, T, E+, C+, T+) Trip-Phase B (A, E, C, T, E+, C+, T+) Trip-Phase C (A, E, C, T, E+, C+, T+)		
I>>>	1 In	40 In	0.01 In
tl>>>	0 s	200 s	0.01 s

### Three-Phase Overcurrent (50/51) & Earth Fault Overcurrent (50N/51N) (cont.)

Three independent stages are available both for phase and earth fault protection. For the first and second (50/51 only) stages the user may independently select a definite time delay (DMT) or an inverse time delay (IDMT) with different types of curves (IEC, IEEE, RI, RECT, RXIDG, BNP EDF).

Each stage and related time-delay can be programmed to provide adjust selectivity.

The IDMT stages have a selectable reset feature: DMT (0 to 600 s) or an IDMT timer so as to reduce clearance times when intermittent faults occur.

The PowerLogic P1 relays have separate instantaneous and delayed indications for each stage and output relays and LEDs can be configured to indicate the faulted phase(s).

Each protection stage can be disabled, configured to trip a circuit-breaker or to issue an ALARM signal only.

Functions	Setting range		
	min.	max.	Steps
<b>[50/51N] Phase-earth non directional overcurrent</b>			
<b>High sensitivity current set</b>			
(0.01-2I <sub>len</sub> )			
IN_1 (IN>)	0.01 I <sub>len</sub>	0.2 I <sub>len</sub> (IDMT) 2.0 I <sub>len</sub> (DMT)	0.01 I <sub>len</sub>
IN_2 (IN>>)	0.05 I <sub>len</sub>	2.0 I <sub>len</sub>	0.01 I <sub>len</sub>
IN_3 (IN>>>) (E, C, T, E+, C+, T+)	0.05 I <sub>len</sub>	2.0 I <sub>len</sub>	0.01 I <sub>len</sub>
<b>Low sensitivity current set</b>			
(0.05-12I <sub>len</sub> )			
IN_1 (IN>1)	0.05 I <sub>len</sub>	1.2 I <sub>len</sub> (IDMT) 12 I <sub>len</sub> (DMT)	0.01 I <sub>len</sub>
IN_2 (IN>>)	0.3 I <sub>len</sub>	12 I <sub>len</sub>	0.01 I <sub>len</sub>
IN_3 (IN>>>) (E, C, T, E+, C+, T+)	0.3 I <sub>len</sub>	12 I <sub>len</sub>	0.01 I <sub>len</sub>
<b>[50/51N] Phase-earth non directional overcurrent</b>			
IN_1 (IN>) stage?	Disabled, Trip, Alarm Trip-Inrush BI (A, E, C, T, E+, C+, T+) Trip-Latch (A, E, C, T, E+, C+, T+)		
Delay type	DMT, IEC SI, IEC VI, IEC EI, UK LTI, UK STI, UK RC, RI, IEEE MI, IEEE VI, IEEE EI, US CO2-P20, US CO8, RXIDG, BNP EDF, US CO2-P40, US CO5, US CO6, US CO7, US CO9, US CO11, HV_Fuse		
tIN_1 (tIN>)	0.05 s	200 s	0.01 s
IN_1 (IN>) TMS	0.02	1.50	0.01
IN_1 (IN>) TD	0.02	100	0.01
IN_1 (IN>) Reset Delay Type	DT or IDMT		
DT IN_1 (IN>) tReset	0.00 s	600 s	0.01 s
K (RI)	0.1	10	0.1
IN_2 (IN>>) stage?	Disabled, Trip, Alarm Trip-Inrush BI (A, E, C, T, E+, C+, T+) Trip-Latch (A, E, C, T, E+, C+, T+)		
tIN_2 (tIN>>)	0 s	200 s	0.01 s
IN_3 (IN>>) stage? (Model E)	Disabled, Trip, Alarm Trip-Inrush BI (A, E, C, T, E+, C+, T+) Trip-Latch (A, E, C, T, E+, C+, T+)		
tIN_3 (tIN>>) (Model E)	0 s	200 s	0.01 s

### Switch-on-to-Fault (based on 50/51)

The closing of a circuit breaker might inadvertently lead to a short-circuit fault due to a maintenance ground clamp not yet removed. The PowerLogic P1F relays incorporate a settable switch-on-to-fault protection function. It provides an instantaneous trip over a settable time period after local or remote manual closure.

Inrush current in transformer applications can have an influence on the selectivity of instantaneous trips; the short time-delay (DMT) can therefore be set for this protection element in order to maintain selectivity and make it possible to have a current threshold below any inrush current peak. One independent DMT current stage is available for phase fault protection.

Functions	Setting range		
	min.	max.	Steps
<b>[50/51] SOTF (switch on to fault) (Model B, A and E+)</b>			
SOTF ?	Disabled, Trip, Alarm, Trip with Inrush blocking, Trip Latch		
SOTF	1 In	40 In	0.01 In
tSOTF	0 s	600 s	0.01 s

### Inrush Blocking

The 2nd Harmonic Blocking, in PowerLogic P1F, detects high inrush current inflows that occur upon connection of transformers or rotating machines. The function will block the phase overcurrent and earth fault elements (freely selectable).

Functions	Setting range		
	min.	max.	Steps
<b>Inrush Blocking (Model A, E and E+)</b>			
Inrush Blocking	No, Yes, Closing		
2nd Harmonic Ratio	10%	50%	1%
Inrush Reset Time	0 s	200 s	0.01s
Unblock Inrush Time	0 s	200 s	0.01s

### Negative Sequence Overcurrent (46)

The PowerLogic P1F relays (model E, E+) include a programmable function specially designed to detect unbalanced load or fault conditions. The three stages of negative sequence overcurrent have the same setting ranges and time delay as the phase overcurrent.

Functions	Setting range		
	min.	max.	Steps
<b>[46] Negative Sequence Overcurrent</b>			
I2> ?	Disabled, Trip, Alarm, Trip with Inrush blocking (E, C, T, E+, C+, T+), Trip Latch (E, C, T, E+, C+, T+)		
I2>	0.1 In	4 In	0.01 In
Delay type	DMT, IEC SI, IEC VI, IEC EI, UK LT1, UK ST1, UK RC, RI, IEEE MI, IEEE VI, IEEE EI, US CO2-P20, US CO8, RXIDG, BNP EDF, US CO2-P40, US CO5, US CO6, US CO7, US CO9, US CO11, HV_Fuse		
tl2>	0.05 s	200 s	0.01 s
I2> TMS	0.02	1.50	0.01
I2> TD	0.02	100	0.01
Reset Delay Type I2>	DT or IDMT		
DMT tReset I2>	0.00 s	600 s	0.01 s
RTD/RTMS Reset I2>	0.00 s	600 s	0.01 s

### Blocking Logic

When PowerLogic P1F relays are used in critical networks, the management of protection relays must take surrounding devices into consideration. Any blocking digital inputs can be independently configured to lock any combination of selected elements (i.e. current stages, thermal replica, etc.). A typical application is to use a dedicated digital input to block the time-delayed settings of phase/earth fault protection in a relay in response to the phase/earth fault start condition of a downstream relay.

This function allows the relays to clear the fault quickly and correctly when used in a cascading scheme.

### Broken Conductor (46BC)

A typical unbalanced fault that can occur on the system is an open circuit fault. This fault can arise from broken conductor, discrepancy of one switchgear poles position or blowing of a fuse.

PowerLogic P1F relays (Model E, E+) are able to measure the ratio of negative to positive sequence current (I2/I1). This fully programmable function allows more sensitivity and stability than pure negative sequence measurement

Functions	Setting range		
	min.	max.	Steps
<b>[46BC] Broken Conductor (Model E and E+)</b>			
Broken Cond.?	Disabled, Trip, Alarm, Trip with Inrush blocking (E, C, T, E+, C+, T+), Trip Latch (E, C, T, E+, C+, T+)		
Ratio I2/I1	20%	100%	1%
tBCond>	0.05 s	200 s	0.01 s
Brkn. Cond I< Block	0.1 In	1 In	0.01 In



### Autorecloser (79)

PowerLogic P1F relays (Models E, C, T, E+, C+, T+) include a 4-shot triphase autorecloser. All the programmed protection functions may independently start any of the shots and the user can program which functions are allowed to trip after any of the shots. This makes possible special reclosing cycles e.g. as requested for coordination with fuses in distribution with tapped transformers.

To limit an excessive number of reclosing cycle in a short period of time, a setting can be used to define the maximum number of reclosing cycle allowed in a period of time after first one was detected.

Dead and reclaim times are freely adjustable. A counter stores the number of reclose commands. This information is free locally or remotely. To inform operator that autorecloser has been blocked internally or externally, output relays can be assigned to these signals.

Functions	Setting range		
	min.	max.	Steps
<b>[79] Autoreclose (Models E, C, T, E+, C+, T+)</b>			
Autoreclose ?	Disabled or Enabled		
Dead time tD1	0.01s	600s	0.01s
Dead time tD2	0.01s	600s	0.01s
Dead time tD3	0.01s	600s	0.01s
Dead time tD4	0.01s	600s	0.01s
Reclaim Time tR	0.02s	600s	0.01s
Fast O/C Trip (I>, I>>, I>>>)	Enabled or Disabled for every cycle		
Fast O/C Trip Delay setting	0.00s	9.99s	0.01s
Fast E/GND Trip	Enabled or Disabled for every cycle		
Fast E/GND Trip Delay setting	0.00s	9.99s	0.01s
Close Shot tI>	Enabled or Disabled for every cycle		
Close Shot tI>>	Enabled or Disabled for every cycle		
Close Shot tI>>>	Enabled or Disabled for every cycle		
Close Shot tIN_1 (IN>)	Enabled or Disabled for every cycle		
Close Shot tIN_2 (IN>>)	Enabled or Disabled for every cycle		
Close Shot tIN_3 (IN>>>)	Enabled or Disabled for every cycle		
Close Shot tAUX1	Enabled or Disabled for every cycle		
Close Shot tAUX2	Enabled or Disabled for every cycle		
Inhibit Trip tI>	Enabled or Disabled for every cycle		
Inhibit Trip tI>>	Enabled or Disabled for every cycle		
Inhibit Trip tI>>>	Enabled or Disabled for every cycle		
Inhibit Trip tIN_1 (IN>)	Enabled or Disabled for every cycle		
Inhibit Trip tIN_2 (IN>>)	Enabled or Disabled for every cycle		
Inhibit Trip tIN_3 (IN>>>)	Enabled or Disabled for every cycle		
Inhibit Trip tAUX1	Enabled or Disabled for every cycle		
Inhibit Trip tAUX2	Enabled or Disabled for every cycle		
Ext. CB Faulty Monitoring ?	Yes or No		
Ext. Block via Input?	Yes or No		
Start Dead Time on	Protection Reset or CB trips		
Rolling Demand ?	Yes or No		
Max. cycle number Roll. Dem.	2	100	1
Time period Rolling Demand	1 mn	24 h	1 mn
Time Inhibit on Close tI	0.0 s	600 s	0.01 s
Signaling Reset	No or on Close [79]		

### Trip Via Binary Inputs AUX1, AUX2, AUX3, AUX4

Timers operate if the state of an input mapped to this function changes in such a way that the function will be triggered. Timers can be used for CB tripping or alarm signaling.

This function is available when inputs are energized via an auxiliary power supply.

To upload them, it is possible to use the front USB port (eSetup Easergy Pro and/or PowerLogic Studio) or the rear serial port (DCS). Event records are stored in a non volatile FRAM memory. All events are time-stamped to 1 ms.

Functions	Setting range		
	min.	max.	Steps
<b>Auxiliary timers (Model A, E and E+)</b>			
Aux1 ?	Disabled, Trip, Alarm, Trip-Inrush BI (A, E, C, T, E+, C+, T+), Trip-Latch (A, E, C, T, E+, C+, T+), Load Shedding (E, C, T, E+, C+, T+), AR after LS Hi (E, C, T, E+, C+, T+), AR after LS Lo (E, C, T, E+, C+, T+)		
Time-delay tAux1	0	600 s	0.01s
Aux2 ?	Disabled, Trip, Alarm, Trip-Inrush BI (A, E, C, T, E+, C+, T+), Trip-Latch (A, E, C, T, E+, C+, T+), Load Shedding (E, C, T, E+, C+, T+), AR after LS Hi (E, C, T, E+, C+, T+), AR after LS Lo (E, C, T, E+, C+, T+)		
Time-delay tAux2	0	600 s	0.01s
Aux3 ?	Disabled, Trip, Alarm, Trip-Inrush BI (A, E, C, T, E+, C+, T+), Trip-Latch (A, E, C, T, E+, C+, T+), Load Shedding (E, C, T, E+, C+, T+), AR after LS Hi (E, C, T, E+, C+, T+), AR after LS Lo (E, C, T, E+, C+, T+)		
Time-delay tAux3	0	600 s	0.01s
Aux4 ?	Disabled, Trip, Alarm, Trip-Inrush BI (A, E, C, T, E+, C+, T+), Trip-Latch (A, E, C, T, E+, C+, T+), Load Shedding (E, C, T, E+, C+, T+), AR after LS Hi (E, C, T, E+, C+, T+), AR after LS Lo (E, C, T, E+, C+, T+)		
Time-delay tAux4	0	600 s	0.01s

### Cold Load Pick-Up

PowerLogic P1F cold load pick-up temporarily raises the setting of selectable stages closer to the lad profile in order to avoid unwanted trips. The setting value can be increased by 800% for example for a settable duration. To trigger this function, the CB closed position or current criteria are used.

Functions	Setting range		
	min.	max.	Steps
<b>Cold Load PU</b>			
Cold Load PU ?	Disabled or Current+Input or Input (A, E, C, T, E+, C+, T+)		
Cold load PU Level	20%	999%	1%
Cold load PU tCL	0s	6000 s	0.1 s
CLPU I>	Yes or No		
CLPU I>>	Yes or No		
CLPU I>>>	Yes or No		
CLPU IN_1 (IN>)	Yes or No		
CLPU IN_2 (IN>>)	Yes or No		
CLPU ltherm (NA)	Yes or No		

### Selective Relay Scheme Logic

The PowerLogic P1F relays (Model E, E+) include selective relay scheme logic. A dedicated digital input can temporarily alter the time delay settings in response to the phase/earth fault start condition of a downstream relay.

This function allows the PowerLogic relays to quickly clear the fault when used in a cascade scheme.

Functions	Setting range		
	Min.	Max.	Step
<b>Selective Relay Scheme Logic (Model E+)</b>			
SEL1 ?	Disabled or Enabled		
tSEL1	0.00 s	600.0 s	0.01s
SEL1 tI>>	Yes or No		
SEL1 tI>>>	Yes or No		
SEL1 tIN>>	Yes or No		
SEL1 tIN>>>	Yes or No		
SEL2 ?	Disabled or Enabled		
tSEL2	0.00 s	600.0 s	0.01s
SEL2 tI>>	Yes or No		
SEL2 tI>>>	Yes or No		
SEL2 tIN>>	Yes or No		
SEL2 tIN>>>	Yes or No		

### Output Relay Latching (86)

All output contacts may be latched freely.

Latched outputs can be reset via the activation of a logic input, through the front panel interface or by remote communication.

## Instantaneous Information

Outputs and LEDs can be programmed with instantaneous information from freely selectable protection elements: with or without latching. Additionally, every start of a protection element is recorded in the event recorder and the instantaneous recorder. The instantaneous information is typically generated after the threshold has been exceeded.

## Communication and Synchronization

The PowerLogic P1 offers communication protocols allowing its utilization in most network control and data acquisition systems (via Modbus, IEC 60870-5-103). The protocol can be selected in the P1V and P1F mlt has been designed for permanent multi-drop connection through the rear RS485 communication port.

The PowerLogic P1 incorporates an internal clock to allow 1 ms accuracy time tagging of alarms, events, fault and disturbance records. To avoid any drifting of the time-tagging clock, it's necessary to periodically synchronize the relays.

## Two Setting Groups

External conditions may require the need for different settings or I/O configuration. The PowerLogic P1 provides two independent setting groups. The active setting group can be switched from the local HMI or due to external conditions (digital input change of state or DCS control).

The two setting groups include protection settings, binary input, output and LED configuration.

## Local/Remote Mode of CB Commands

The goal of this feature is to make it possible to block commands sent remotely through communication networks (such as setting parameters, control commands, etc.) that could cause accidents or maloperation during maintenance work performed on site.

The local mode can be set via a digital input assigned to this feature or an RS485. The local mode state can be indicated via the configured LED.

## Circuit Breaker/Contactor Command

Circuit breaker control is available from the front panel user interface, optically-isolated inputs and remotely via substation communications. Circuit breaker control is also possible via the function keys (Close/Open).

For contactor application the output contact has to be configured with reverse logic & latching.

It is possible to send a local open/close command through the HMI upon operator confirmation.

## Circuit Breaker Condition Monitoring

The circuit breaker condition monitoring features include:

- Monitoring the number of breaker trip operations
- Recording the sum of the broken current
- Monitoring the breaker operating time

An alarm signal is emitted if the above parameters exceed the settable threshold.

## Fault & Alarm Recording

The last 20 faults and 5 alarms records are stored inside the PowerLogic P1 relays.

Each fault includes: Record number / Fault time / Active setting group / Faulted phase / Protection operation / Magnitude of input quantities.

Fault indication helps the user to clearly identify the fault and monitor the relay's settings and operations as all information is available on the relay HMI.

Fault records are stored in a non-volatile FRAM memory.

### Control and Monitoring Functions

Control & monitoring functions		Setting range		
		Min.	Max.	Step
CB Control time	Models			
tOpen Pulse min	All models	0.1 s	10 s	0.01 s
tClose Pulse	All models	0.1 s	10 s	0.01 s
Time-delay for Close	Models B, A, E, E+	0.0 s	200 s	0.01 s
Time-delay for faulty CB external signal (Model B, A, E and E+)				
tCB FLT ext		1 s	200 s	1 s
Remote control mode (Model A, E and E+)				
Remote CTRL Mode		Remote only Remote + Local		
[52] Unblock SOTF Time Pulse after CB Close (Model B, A, E and E+)				
52 Unblock SOTF Time		0 s	200 s	0.01 s
Trip Circuit (TC) Supervision (Model A, E and E+)				
TC Supervision ?		No Yes Yes / 52A		
TC Supervision tSUP		0.1 s	10 s	0.01 s
Circuit breaker control and monitoring setting ranges (Model A, E and E+)				
Max CB Open Time	0.01 s	10 s	0.01 s	
Max CB Close Time	0.01 s	10 s	0.01 s	

### Disturbance Records

Disturbance records (P1F model A, E, E+)				
Functions		Value		
Triggers		Any protection stage selected to trip CB, logical input , remote command		
Data		AC input channels Digital input and output states		
Functions	Default value	Setting range		
		Min.	Max.	Step
Pre-fault Time	0.1	0.1	2	0.01
Post-fault Time	0.1	0.1	1	0.01
Max duration time	1	0.10	4 (A, E, C, T) 3 (E+, C+, T+)	0.01
Disturb rec Trig	on Inst.	on Trip on Inst.		
Trigger	Start signal of protection selected for tripping Trip signal of protection selected for tripping Logic input (Start Distur.R.)			
Event records (not available in model L without RS485)				
Capacity	200 events			
Time-tag	1 millisecond			
Triggers	Any selected protection alarm and threshold Logic input change of state Setting changes Self test events			
Fault records				
Capacity	20 faults			
Time-tag	1 millisecond			
Triggers	Any selected protection which trip CB			
Data	Fault date Protection thresholds Setting Group AC inputs measurements Fault measurements			
Alarm recorder				
Capacity	5 alarm information			
Time-tag	1 millisecond			
Triggers	Any selected protection which is selected for signaling only (set to Alarm)			
Data	Date, hour, origin (any protection alarm)			



### Customer Benefits

**Easy to use**

Easy to use with EcoStruxure™ Power Operation  
Help economize your time and money

**Flexible**

Help optimize your investment

**Reliable**

Help reduce risk and power outage  
Strive for sustainability

## Main Features

PowerLogic P1V is a basic numerical relay that helps to provide reliable and effective voltage and frequency protection with automation, control and measurement functions. It may be applied to all low voltage or medium voltage applications as a primary or back-up protection device.

PowerLogic P1V has always been strongly linked to flexible and easy-to-use protection relays. It inherits the well known MiCOM Px10 and VAMP 11V series. With attention to simplicity and cost effectiveness, the PowerLogic P1V becomes the reference for the most efficient devices for standard protection applications.

Thanks to the cost to functionality ratio, the PowerLogic P1V is an innovative solution that is tailored to user's needs and can be applied in any type of low or medium voltage network where voltage or frequency protection is required.

Many selectable options embedded in the relay offer a high level of flexibility in terms of application and maintenance. VT ratio, communication protocol, HMI language or independent settings of hysteresis for under or over-voltage protection are all selectable in the menu. Moreover, only 3 relay models are used to accommodate specific applications and operating conditions. This approach helps optimize the protection to the requirements and helps minimize wasted functionality and cost. A unique list of only 10 model variants (type designations) cover all model, voltage input range and auxiliary power supply options, meaning that ordering and spares holding is simplified for ease of use.

Switchable serial communication (IEC 60870-5-103 or Modbus) allows the device to connect to almost any kind of SCADA system. A front USB port and multilingual HMI makes PowerLogic P1V user-friendly with reduced maintenance costs.  
Easy to use with EcoStruxure™ Power Operation.

PowerLogic P1V is housed in a standard flush mounting case which can be complemented by two optional accessories:

- Wall mounting adaptor
- Transparent plastic front cover to limit unauthorized access.


## Application

PowerLogic P1V is a basic numerical relay provides reliable and effective voltage or voltage and frequency protection with automation, control and measurement functions. Typical applications are:

- LV or MV applications
- Primary or back-up protection device
- Retrofit of electromechanical relay



DB446478

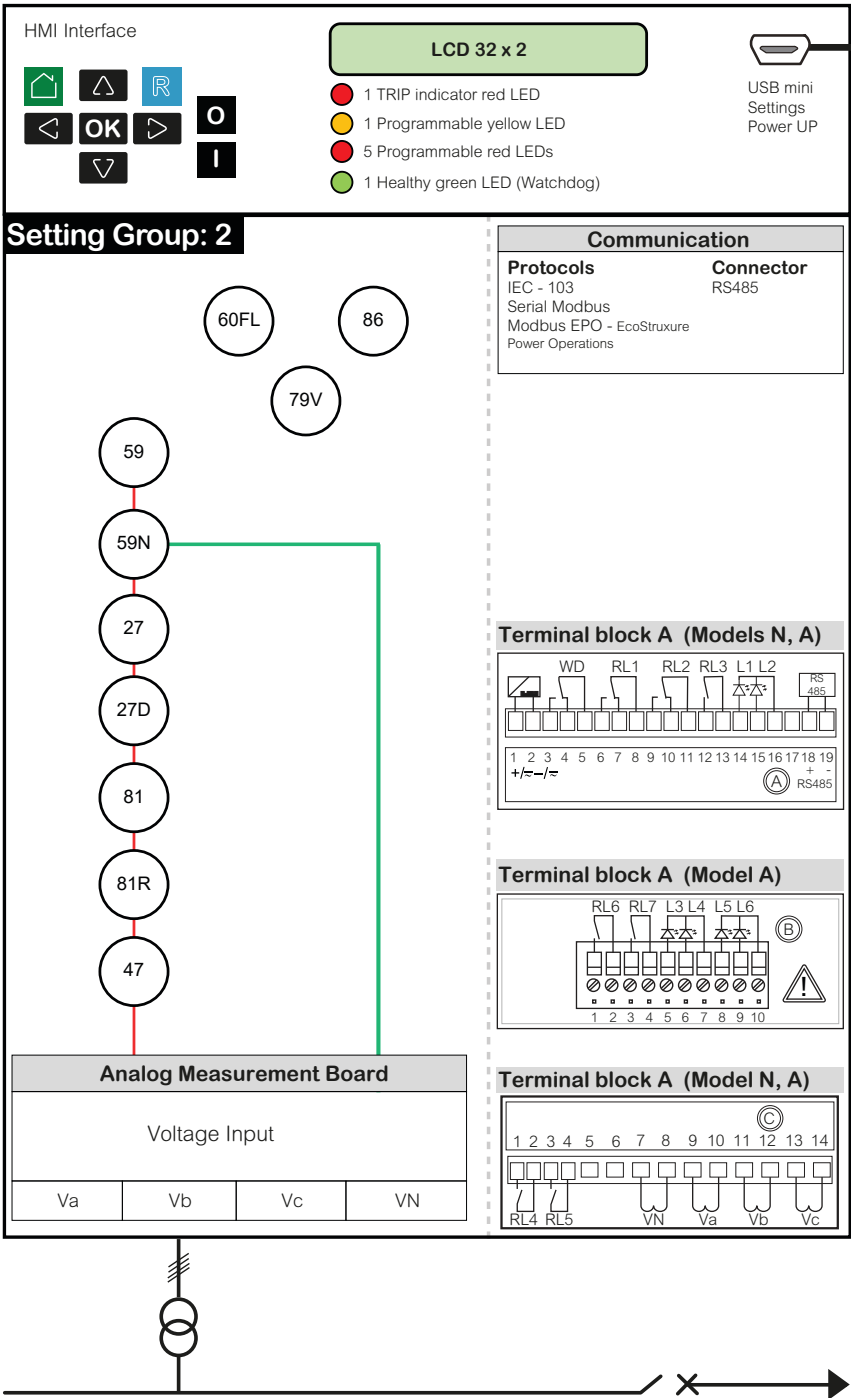

eSetup  
Easergy Pro

IEEE device no.	PowerLogic™ P1V functions	Model L	Model N	Model A
	Phase-to-neutral or phase to phase voltage protection	•	•	•
27	Phase undervoltage (AND/OR logic)	•	•	•
59	Phase overvoltage (AND/OR logic)	•	•	•
59N	Neutral voltage displacement		•	•
59N	Derived Vo sequence overvoltage	•	•	•
47	Negative sequence overvoltage		•	•
27D	Positive sequence undervoltage			•
81U/81O	Under/Over frequency			•
81R	Rate of change of frequency (RoCoF)			•
86	Output relay latching	•	•	•
79V	Auto-recloser based on Frequency			•
	Blocking logic		•	•
	Settable hysteresis	•	•	•
	Binary inputs	0	2	6
	Output relays	3	5	7
	Watchdog contact	1	1	1
	Phase voltage inputs	3	3	3
	Neutral voltage		1	1
	Remote communication (RS485)		•	•
	Remote communication (RS485)		Modbus / IEC103	Modbus / IEC103
	Mini-USB		•	•
	Powering thru mini-USB front port			•
	Event recording		200	200
	Fault recording	20	20	20
	Disturbance recording			4 s
	CB condition monitoring and Counters			•
	Setting groups	2	2	2
	Time synchronization (via binary input)			•
	VT Supervision		•	•
	CB Supervision		•	•
	CB control via front keys / RS485 / Binary input	•/-/-	•/•/-	•/•/•

### Three Phase Undervoltage (27) and Positive Sequence Undervoltage (27D) Protection

Three independent stages are available for undervoltage (27) and two independent stages for positive sequence undervoltage (27D). The user can set the first stage with definite time delay (DMT) or inverse time delay (IDMT) with different types of curves (see below). Each stage and related time delay can be programmed to provide maximum selectivity.

In both functions the first stage reset delay type can be selected between DMT or IDMT timer to reduce clearance times when intermittent faults occur. The PowerLogic P1V relay has separate instantaneous and delayed indications for each stage. Output relays and LEDs can be configured to indicate the faulted phase(s). Each protection function can be disabled, enabled, configured to trip a circuit breaker or as alarm signal only.

Each three phase voltage protection function in PowerLogic P1V (under, and overvoltage function) can be set to "OR Trip" or "AND Trip". This means that in case of "OR Trip" the protection function will operate when the pick-up condition is fulfilled for at least one of the three phases. In case of "AND Trip" protection function will operate when a pick-up condition is fulfilled in all three phases.

Consequently, the relay will indicate alarms in the same way if the voltage protection functions are set to "OR Alarm" or "AND Alarm".

Functions	Setting range		
	min.	max.	Steps
<b>Undervoltage</b>			
V<?	Disabled OR Trip OR Alarm AND Trip AND Alarm OR Trip/52a (N,A) OR Alarm/52a (N,A) AND Trip/52a (N,A) AND Alarm/52a (N,A)		
V< Threshold	5 V 20 V	130 V 480 V	0.1 V 0.1 V
V< Delay type	DT, IEC_SI, IEC_VI, IEC_EI, IEC_LTI, UK_STI, RECT, RI, IEEE_MI, IEEE_VI, IEEE_EI, CO2_Px20, US_CO8, RXIDG, BPN_EDF, CO2_Px40		
tV</TMS/TD	0.02 s	200 s	0.01 s
V< Reset Delay Type	DT High State IDMT		
V< DMT tReset	0 s	600 s	0.01 s
V<<?	Disabled OR Trip OR Alarm AND Trip AND Alarm OR Trip/52a (N,A) OR Alarm/52a (N,A) AND Trip/52a (N,A) AND Alarm/52a (N,A)		
V<< Threshold	5 V 20 V	130 V 480 V	0.1 V 0.1 V
tV<<	0.02 s	200 s	0.01 s
V<<<?	Disabled OR Trip OR Alarm AND Trip AND Alarm OR Trip/52a (N,A) OR Alarm/52a (N,A) AND Trip/52a (N,A) AND Alarm/52a (N,A)		
V<<< Threshold	5 V 20 V	130 V 480 V	0.1 V 0.1 V
tV<<<	0.02 s	200 s	0.01 s

### Three Phase Overvoltage (59)

PowerLogic P1V relays offer three independent stages both for phase and earth fault protection. For the first stage (59) it is possible to set a definite time delay (DT) or an inverse time delay (IDMT) with different types of curves (see below). Each stage and related time delay can be programmed to provide maximum selectivity.

In both functions the first stage reset delay type can be selected between DT or IDMT timer to reduce clearance times when intermittent faults occur. Phase overvoltage protection function (59) can also be configured as the undervoltage function ("OR TRIP", "AND TRIP", "OR Alarm", "AND Alarm" etc.).

The PowerLogic P1V relay has separate instantaneous and delayed indications for each stage. Output relays and LEDs can be configured to indicate the faulted phase(s). Each protection function can be disabled, enabled, configured to trip a circuit breaker or as alarm signal only.

Each protection stage can be selected to Trip the CB (works when all three phases are faulty – AND option, or if in any one phase fault appears – OR option) or to indicate a signal (Alarm) only, there is possibility to choose trip and alarm with blocking option from state of CB contacts (52a).

Functions	Setting range		
	min.	max.	Steps
<b>Overvoltage</b>			
V> ?	Disabled OR Trip, OR Alarm, AND Trip, AND Alarm, OR Trip/52a (N,A), OR Alarm/52a (N,A), AND Trip/52a (N,A), AND Alarm/52a (N,A)		
V> Threshold	5 V	200 V	0.1 V
	20 V	720 V	0.1 V
V> Delay Type	DT, IEC_SI, IEC_VI, IEC_EI, IEC_LTI, UK_STI, RECT, RI, IEEE_MI, IEEE_VI, IEEE_EI, CO2_Px20, US_CO8, RXIDG, BPN_EDF, CO2_Px40		
tV> /TMS/TD	0.02 s	200 s	0.01 s
V> Reset Delay Type	DT High State IDMT		
V> DMT tReset	0 s	600 s	0.01 s
V>> ?	Disabled OR Trip, OR Alarm, AND Trip, AND Alarm, OR Trip/52a (N,A), OR Alarm/52a (N,A), AND Trip/52a (N,A), AND Alarm/52a (N,A)		
V>> Threshold	5 V	200 V	0.1 V
	20 V	720 V	0.1 V
tV>>	0.02 s	200 s	0.01 s
V>>> ?	Disabled OR Trip, OR Alarm, AND Trip, AND Alarm, OR Trip/52a (N,A), OR Alarm/52a (N,A), AND Trip/52a (N,A), AND Alarm/52a (N,A)		
V>>> Threshold	5 V	200 V	0.1 V
	20 V	720 V	0.1 V
tV>>>	0.02 s	200 s	0.01 s

IDMT tripping can be blocked if any DMT stage is started, settings: IDMT interlock by DMT (GLOBAL SETTINGS/O/V ADVANCED column). These settings is common for E/Gnd Fault O/V [59N], Phase O/V [59] and Phase U/V [27].

### Earth Fault Overvoltage (59N)

In the PowerLogic P1V relays the earth fault element operates from a measured (NA) or calculated from phase to neutral or phase to phase voltages (L) earth fault voltage value.

The first earth fault stage has time-delayed characteristics which are selectable between inverse definite minimum time (IDMT) and definite time (DT). The second and third stages have a definite time characteristic only.

Functions	Setting range		
	min.	max.	Steps
<b>Earth fault overvoltage</b>			
VN> ?	Disabled, Trip (measured) (N,A), Alarm (measured) (N,A), Trip (Ua+Ub+Uc), Alarm (Ua+Ub+Uc)		
VN> Threshold	0.5 V	130 V	0.1 V
V> Delay Type	DT, IEC_SI, IEC_VI, IEC_EI, IEC_LTI, UK_STI, RECT, RI, IEEE_MI, IEEE_VI, IEEE_EI, CO2_Px20, US_CO8, RXIDG, BPN_EDF, CO2_Px40		
tVN> /TMS/TD	0.02 s	200 s	0.01 s
VN> Reset Delay Type	DT High State IDMT		
VN> DMT tReset	0 s	600 s	0.01 s
VN>> ?	Disabled, Trip (measured) (N,A), Alarm (measured) (N,A), Trip (Ua+Ub+Uc), Alarm (Ua+Ub+Uc)		
VN>> Threshold	0.5 V	130 V	0.1 V
tVN>>	0.02 s	200 s	0.01 s
VN>>> ?	Disabled, Trip (measured) (N,A), Alarm (measured) (N,A), Trip (Ua+Ub+Uc), Alarm (Ua+Ub+Uc)		
VN>>> Threshold	0.5 V	130 V	0.1 V

### Auto Reclose (79V) - Based on Voltage

The recloser automatically closes the circuit breaker (CB) after the necessary time delay to allow the insulation to be restored.

Functions	Setting range		
	min.	max.	Steps
A_CB control	Disable, Enable		
A_CB Enable input	Not set, Input1, Input2, Input3, Input4, Input5, Input6		
A_CB control delay	0.05 s	25 s	0.01 s
A_CB Trigger	Phase O/V > Phase O/V >> Phase U/V < Phase U/V << Frequency [81-1] Frequency [81-2] ROCO F1 ROCO F2		

### Negative Sequence Overvoltage (47)

This function is used for protection of the system against unbalanced voltage conditions in the network.

It offers two independent stages, first stage V2> can be set for definite time delay (DMT) or an inverse time delay (IDMT) with typical characteristics. Second stage V2>> can be set to definite time delay only.

Functions	Settings	Default settings
<b>Negative sequence overvoltage</b>		
V2> ?	Disabled Trip Alarm Trip/52a Alarm/52a	Disabled
V2> Threshold	5...200 V (step: 0.1 V) 20...720 V (step: 0.1 V)	20 V (for 57...130 Vac) 20 V (for 220...480 Vac)
V2> Delay Type	DT IEC_SI IEC_VI IEC_EI IEC_LTI UK_STI RECT RI IEEE_MI IEEE_VI IEEE_EI CO2_Px20 US_CO8 RXIDG BPN_EDF CO2_Px40	DT
tV2> /TMS/TD	0.02... 200 s (step: 0.01 s)	0.02 s
V2> Reset Delay Type	DT High State IDMT	DT High State
V2>> ?	Disabled Trip Alarm Trip/52a Alarm/52a	Disabled
V2>> Threshold	5... 200 V (step: 0.1 V) 20... 720 V (step: 0.1 V)	40 V (for 57...130 Vac) 40 V (for 220...480 Vac)
tV2>>	0.02... 200 s (step: 0.01 s)	0.02 s

### Measurements

The PowerLogic P1V series offers a complete set of measurement functions to replace the conventional metering functions of switchgear and control gear installations.

The measurement functions cover phase and residual voltages, system frequency and harmonics from phase voltages. Basic condition monitoring, breaker wear and voltage transformers.

All measurements are available locally or remotely.

Depending on the configuration of the VTs connected and chosen model, PowerLogic P1V provides full measurements and displays them as true RMS values on the screen:

- Phase-to-neutral voltages Va, Vb, Vc
- Phase-to-phase voltages Vab, Vbc, Vca
- Neutral voltage VN (calculated in model L, measured or calculated in models N and A)
- Frequency ([model A](#))
- Positive sequence of voltage ([model A](#))
- Negative sequence of voltage ([models N, A](#))

### Frequency Protection (81O/81U)

The frequency protection function has two possibilities of operation: under-frequency and overfrequency.

Underfrequency is used to detect abnormal, low frequency conditions in comparison to the rated frequency, while overfrequency option can detect abnormal, higher frequency conditions.

The frequency element included in the PowerLogic P1V relay provides six stages of non-directional overfrequency or underfrequency protection with independent time-delay characteristics.

These characteristics are only definite time (DT) characteristic.

Functions	min.	Setting range max.	Steps
<b>Frequency protection</b>			
f1 ?	Disabled		
f2 ?	f> Trip		
f3 ?	f> Alarm		
f4 ?	f< Trip		
f5 ?	f< Alarm		
f6 ?			
f1 Threshold	40 Hz @ 50 Hz	60 Hz @ 50 Hz	0.01 Hz
f2 Threshold	50 Hz @ 60 Hz	70 Hz @ 60 Hz	
f3 Threshold			
f4 Threshold			
f5 Threshold			
f6 Threshold			
tf1	0.1 s	600 s	0.01 s
tf2			
tf3			
tf4			
tf5			
tf6			

### Rate of change of frequency - ANSI 81R

This function (ROCOF) is applied to detect the rate of change of system frequency, for fast load shedding or fast disconnection of islanded generators under loss of main condition.

- Two independent stages with definite time delay.
- Direction of frequency change is settable.
- Automatically inhibited if the maximum phase to phase voltage goes below the setting threshold.

Functions	Settings
Options	Disable, df/dt trip, df/dt alarm, F+df/dt trip, F+df/dt alarm
Direction	Negative, positive, and either
Pick up set	0.1 to 10 Hz/s
Frequency threshold	40 to 65 Hz
Measurement window	0.05 to 10 s
Operation delay	0 to 100 s
Reset delay	0 to 1 s
ROCOF block	No, Yes



### Blocking Logic

When PowerLogic P1V is used in a critical network, it must take into consideration all surrounding devices. A locking digital input can be independently configured to lock any combination of selected elements. This function allows the relay to activate quickly and correctly when applied in a cascading scheme.

### Relay Output Latching (86)

All relay outputs may be latched freely. Latched outputs can be reset via the activation of a logic input, through the front panel interface or by remote communication.

### Instantaneous Information

Outputs and LEDs can be programmed with instantaneous information from freely selectable protection elements: with or without latching. Additionally, every start of a protection element is recorded in the event recorder and the instantaneous recorder. The instantaneous information is typically generated within 30ms after the threshold has been exceeded.

### Trip Via Binary Inputs

Binary inputs are freely configured to timers AUX1 - AUX5. When an external voltage triggers the input, the protection function will operate. This external trip functionality may be used with a Buchholz relay or any other protection device.

### Two Setting Groups

External conditions may require the need for different settings or input / output configuration. The PowerLogic P1V offers two independent setting groups to make life easy and efficient. The active setting group can be switched from the local HMI or remotely via a digital input state change, or SCADA system command. The two setting groups include protection settings, binary inputs, relay outputs and LEDs.

### Input or Output Configuration

All inputs and outputs can be freely configured for available functions (blocking of protection element, LED reset, outputs reset, start, trip of every protection element, etc.). All inputs and outputs can be assigned to any predefined function.

### Relay Maintenance Mode

The PowerLogic P1V incorporates direct control of the output relays (without the need to inject any current). This functionality allows the user to quickly check the external wiring of the relay's output contacts for simplified commissioning.

### Local/Remote Mode of CB Commands

Local or remote operating mode can be enabled or disabled via a digital input, or via the RS 485 communication port. This operating mode can be indicated via the LED configuration. The goal of this feature is to block commands sent remotely through the communication port (settings, control commands etc.) when in local mode. This minimizes accidents or maloperation during maintenance work on site.

### Circuit Breaker or Contactor Commands

Depending on the model chosen, circuit breaker control is available from:

- Front panel user interface (open/close)
- Optically isolated digital inputs
- Remote substation communication.

### Circuit Breaker Condition Monitoring

The circuit breaker condition monitoring features include:

- Monitoring the number of breaker trip operations
- Monitoring the breaker operating time

An alarm signal is emitted if the above parameters exceed the settable threshold.

### Self Monitoring

Comprehensive self-monitoring procedures within the P1V aim to identify possible issues before they cause malfunction.

A functional self-test is carried out whenever the auxiliary voltage is turned on.

The result of the diagnostics is stored in non-volatile memory and determines whether the protection unit will be blocked, alarmed, or healthy.



Presentation

All functions, including protection, automation, communication, LEDs, inputs and outputs, can be programmed and modified using the front panel user interface (Human Machine Interface).  
The LCD informs the user about settings, measurements & faults with a pull-down menu structure allowing easy and quick access to any data.

Working Language

The relay display language can be changed in the menu system.  
All the texts and messages displayed on HMI are available in:

- **P1F:** English/German/French/Spanish/Russian/Turkish /Regional. (Polish or Portuguese can overwrite on “Regional” )
- **P1V:** English/German/French/Spanish/Turkish

Wiring

External connections are made via screw terminals. The screw terminals allow connection of threaded wires of up to 2.5 mm<sup>2</sup> or solid wires of 4 mm<sup>2</sup> of conductor cross section, with the exception of current terminals that have up to 4mm<sup>2</sup> for threaded wires and 6mm<sup>2</sup> for solid wires

Type port	Physical link	Connectors	Data rate	Comms. mode	Protocol
RS485	Screened twisted pair	Screws or snap-on	4800 or 9600 or 19200 or 38400 or 57600 or 115200 (default:19.2 kbit/s)	Data Bit: 8 Stop bit: 1/ 2 Parity: None/Odd/Even Address: 1 to 247	Modbus RTU, IEC 60870-5-103, Modbus PO (selectable in menu)
USB	USB2.0	PC: type A male PowerLogic P1: type mini B male	4800 or 9600 or 19200 or 38400 or 57600 or 115200 or 187500 kbits/s	Data Bit:8 Stop bit: 1 Parity: None Address: 1	GetSet default Modbus RTU IEC 60870-5-103

# Base Unit Description

## Front and Rear Panel Description


### Front Panel Description

- 1 – Red “Trip” LED
- 2, 3, 4, 5, 6, 7, – Freely programmable LED (second LED is yellow, rest of them red)
- 8 – Green “Healthy” LED (Watchdog)
- 9 – Display (graphic liquid crystal display - LCD)
- 10 – Home key
- 11 – Reset/Clear key
- 12 – 4 arrow keys, and confirm entry OK key
- 13 – CB Open key
- 14 – CB Close Key
- 15 – Mini USB type B for local connection



### Rear Panel Description

PowerLogic™ P1F	PowerLogic™ P1V
Terminal block A	
Power supply	Power supply
Output contacts: WD, RL1-RL3	Output contacts: WD, RL1-RL3
Binary inputs: L1, L2	Binary inputs: L1, L2
RS485 (Except Model L)	RS485 (Except Model L)
Terminal block B	
Output contacts RL6, RL7 ( <b>model A</b> ) or RL4, RL5 ( <b>model E, C, T, E+, C+, T+</b> )	Output contacts RL6, RL7 ( <b>model A</b> )
Binary inputs: L3, L4 ( <b>model A</b> ) L5, L6, L7, L8 ( <b>model E, C, T, E+, C+, T+</b> )	Binary inputs: L3, L4, L5, L6 ( <b>model A</b> )
Terminal block C	
Current analog inputs (phases and earth)	Phase voltage analog inputs
Traditional CTs ( <b>models L, N, B, A, E, E+, C, C+</b> )	
LPCTs ( <b>models T, T+</b> )	
Output contacts RL4, RL5 ( <b>models N, A</b> )	Earth voltage analog input ( <b>models N, A</b> )
Binary inputs: L3, L4 ( <b>models E, C, T, E+, C+, T+</b> )	Output contacts RL4, RL5 ( <b>models N, A</b> )

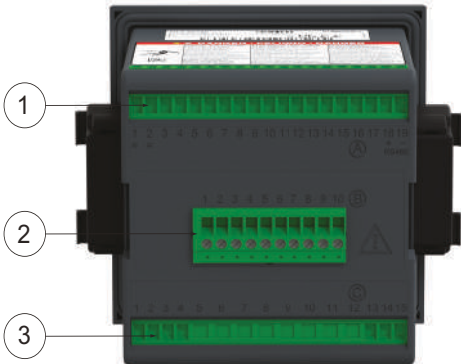



Case

All the models of PowerLogic P1 have a flush mounting plastic case:


Dimensions	
Height	116.5 mm
Width	116.5 mm
Total depth	119 mm
Weight	
PowerLogic P1	approx.0.8 Kg

Wall mounting solution is possible by using the wall mounting adapter (accessories).

Dimensions & Weight

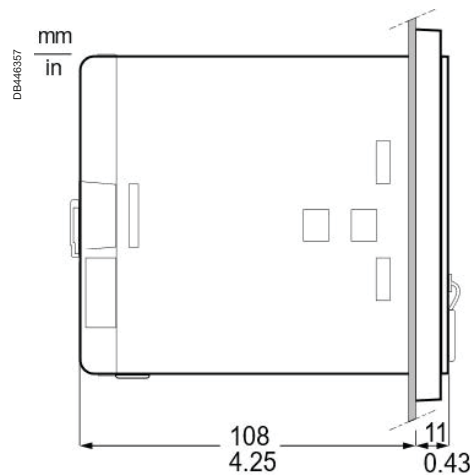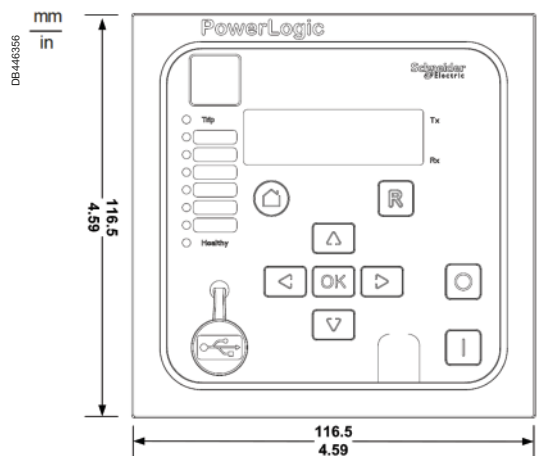

Dimensions of Cut Out

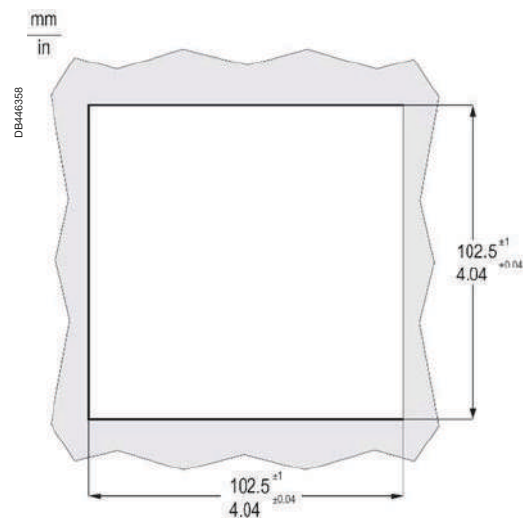

# Base Unit Characteristics

## Environmental Characteristics

EMC Tests	Standard	Value
Ambient Temperature Range	EN60255-1 EN60068-2-1 EN60068-2-2	<i>Operating temperature range:</i> -25...+60 °C (-13...+140 °F) <i>Short time operation temperature range (&lt;16h):</i> -30...+70 °C (-22...+158 °F) <i>Storage and transit:</i> -30...+70 °C (-22...+158 °F)
Ambient Humidity Range	EN 60068-2-78 EN 60068-2-30	21 days at 93% relative humidity and +40 °C 10 days at 93% relative humidity and +60 °C Damp heat cyclic, six (12 + 12) hour cycles, 93% RH, +25...+55 °C
Vibration Test	EN 60255-21-1	Response class 1, 0,5 g <sub>n</sub> ; 10...150 Hz Endurance class 1, 1 g <sub>n</sub> ; 10...150 Hz
Shock and Bump	EN 60255-21-2: 1995	Shock response class 1, 5 g <sub>n</sub> /11 ms Shock withstand class 1, 10 g <sub>n</sub> /16 ms Bump class 1, 15 g <sub>n</sub> /11 ms
Seismic	EN 60255-21-3	2 g <sub>n</sub> horizontal/1 g <sub>n</sub> vertical
Enclosure Protection	EN 60529	IP 40 Protection for relay housing IP 20 Protection for terminals. IP 54 Protection (front panel) against dust and dripping water for flash mounted case.

EMC Directives	Standard
EMC Compliance	Compliance with the European Commission's EMC Directive Product Specific Standards were used to establish conformity: EN 60255-26: 2009 EN 60255-1: 2010
Safety Objectives for Electrical Equipment	Compliance with the European Commission's Low Voltage Directive. Compliance is demonstrated by reference to generic safety standards : EN60255-27:2005

04/10/16/EN



2014/30/EU

04/10/16/EN



2006/95/EC

### Auxiliary Power Supply Vx

Nominal auxiliary voltage Vx	24...250 Vdc/24...240 Vac (50/60 Hz) (Models L, N and E+)
Operating range	19...300 Vdc/19...265 Vac (50/60 Hz) (Models L and N)
Tolerable AC ripple	Up to 15% for a dc supply, per IEC 60255-11

### Nominal Burden

	DC values	AC values
Rated Voltage	24...60 V + 10%/- 20%	24...60 V + 10%/- 20%
	90...250 V + 10%/- 20%	90...250 V + 10%/- 20%
Ripple content	15%	-
Frequency	-	40...70 Hz
Typical consumption	24 V - 2.5 W	24 V - 4.0 VA
	240 V - 2.5 W	240 V - 10.5 VA
Maximum consumption	24 V - 4.0 W	24 V - 6.0 VA
	240 V - 4.0 W	240 V - 13.5 VA
Acceptable momentary outages*	24 V - 20 ms	24 V - 20 ms
	240 V - 1.2 s	240 V - 2.1 s

(\*) Half of the binary inputs and half of the output relays should be energized. Communication modules should be activated (EN 60255-26)

### Auxiliary Power Supply Voltage Interruption

0% residual voltage,  
5 s (50 Hz), 5 s (60 Hz)  
5 s (dc)

### Power-up Time for Auxiliary Supply Voltage Only

Time to power up via auxiliary supply: < 0.5 s

# Ratings

## Current and Voltage Inputs

### Frequency (current and voltage inputs)

Nominal frequency	50 Hz or 60 Hz (selectable in P1V and P1F menu)
-------------------	---

### Phase current inputs (PowerLogic™ P1F)

Nominal current (In)	1 A or 5 A (selectable via HMI)
RMS measurement in range	40...1000 Hz
Fundamental harmonic measurement in range	40...70 Hz
Operating range	0.1...40 In
Nominal Burden at In	< 0.3 VA at In=5 A < 0.1 VA at In=1 A
Thermal withstand	1 s @ 100 x rated current 2 s @ 40 x rated current 10 s @ 30 x rated current continuous: 4 x rated current

### LPCT inputs (PowerLogic™ P1F)

Nominal current - LPCT (In)	2.5 A...20 kA
LPCT rated primary current	10 A...5 kA
LPCT rated secondary voltage	22.5 mV
Current factor	0.25; 0.50; 1.00; 1.25; 1.33; 2.00; 2.50; 3.20; 4.00; 5.00; 6.30; 6.66; 10; 16; 20; 25; 31.5
Linear range	40 x Nominal current

### Earth current inputs (PowerLogic™ P1F)

Nominal current (Ien):	1 A or 5 A (selectable via HMI)
Fundamental harmonic measurement in range	40...70 Hz
Operating range	Selected at order (Cortec) 0.01...2 Ion 0.05...12 Ion
Nominal Burden at Ion	< 0.3 VA at In=5 A; < 0.1 VA at In=1 A
Thermal withstand	1 s @ 100 x rated current 2 s @ 40 x rated current 10 s @ 30 x rated current continuous @ 4 x rated current
Ion: earth fault input nominal current (Ien)	

### Voltage (VN) Analog VT Inputs

Nominal voltage range	57...130 Vac
Input impedance	40 kOhms
Operation range	5...130 Vac
1st harmonic measurement in range	40...70 Hz
Nominal burden at voltages	57 V      0.08 VA 100 V      0.25 VA 110 V      0.3025 VA



# Ratings

## Frequency and Current Inputs

Binary inputs (optically isolated inputs)			
Characteristics	Application to hardware option	DC Values	AC values
Operating range	24...60 Vac/dc	19...66 V	19...66 V
	90...240 Vac/250 Vdc	72...275 V	72...264 V
Typical switching threshold	24...60 Vac/dc	13 V	12 V
	90...240 Vac/250 Vdc	42 V	40 V
Maximum polarization current approx.	24...60 Vac/dc	12 mA (66 V)	12 mA (66 V)
	90...240 Vac/250 Vdc	2.5 mA (275 V)	2.5 mA (264 V)
Maximum continuous withstand	24...60 Vac/dc	66 V	66 V
	90...240 Vac/250 Vdc	300 V	264 V
Filtering time	24...60 Vac/dc	30 ms	30 ms
	90...240 Vac/250 Vdc	30 ms	30 ms

Binary input energy consumption		
Logic input burden for Vx	24...60 Vac/dc	R input = approx. 6 kOhms
	90...240 Vac/250 Vdc	R input = approx. 109 kOhms
Logic input recognition time	24...60 Vac/dc	As filtering time + 2 ms
	90...240 Vac/250 Vdc	As filtering time + 2 ms

# Ratings

## Output Relay Characteristics

### Contact ratings

Contact relay	Dry contact, Ag Ni
Carry capability	5 A continuous
Rated Voltage	250 Vac

### Breaking characteristics for RL1, RL3 and WD

Making capacity	250 V, 30 A, 200 ms 2000 operations
AC breaking capacity	1250 VA resistive ( $\cos \phi = \text{unity}$ ) 1250 VA inductive ( $\cos \phi = 0.7$ )
DC breaking capacity	250 Vdc 50 W resistive 30 W inductive (L/R = 40 ms)
Operation time	<10 ms

### Durability

Loaded contact	10000 operations minimum
Unloaded contact	100000 operations minimum

### Breaking characteristics for RL4 RL5, RL6, RL7

AC breaking capacity	1250 VA resistive ( $\cos \phi = \text{unity}$ ) 1250 VA inductive ( $\cos \phi = 0.7$ )
DC breaking capacity	250 Vdc 30 W resistive 15 W inductive (L/R = 40 ms)
Operation time	< 10 ms


### Durability

Loaded contact	10000 operations minimum
Unloaded contact	100000 operations minimum

### PowerLogic™ P1V Models: L<sup>(1)</sup>, N, A


#### Variant No. 1

Typical connection: 3 phase VTs

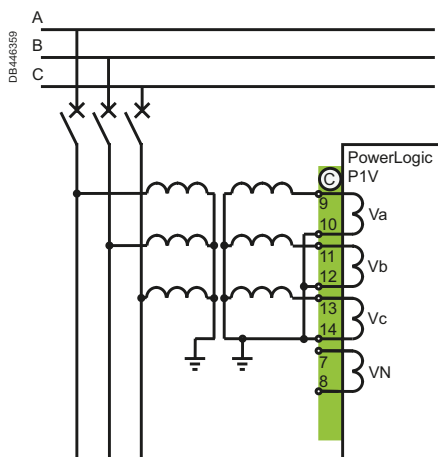


#### Variant No. 2

Typical connection: 3 phase VTs and VN neutral voltage measured from open delta

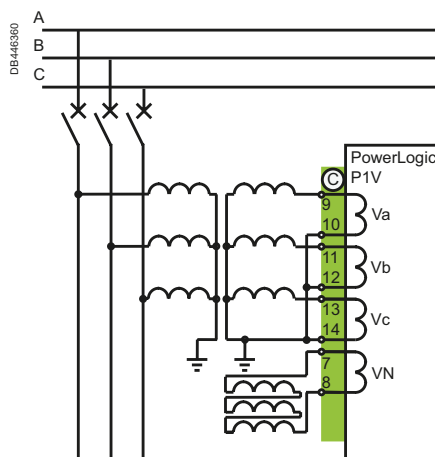


#### Variant No. 3

Typical connection: 2 phase to phase VTs, and VN neutral voltage measured from open delta

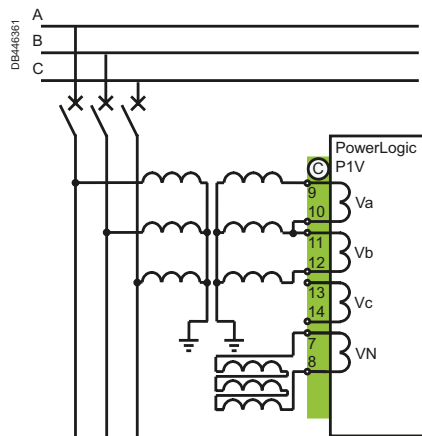

#### Variant No. 4

Typical connection: 3 phase to phase VTs, and VN neutral voltage measured from open delta

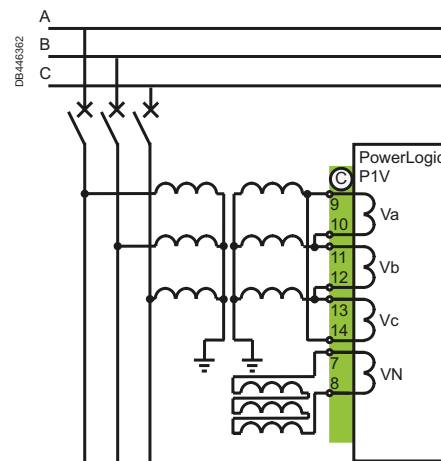

(1) No neutral voltage analog input

# Connection Diagram

## PowerLogic™ P1F



### PowerLogic™ P1F Models: L, N, B, A, E, E+, C, C+

Variant No. 1

Variant No. 2

Typical connection 3 phase CTs

Typical connection 2 phase CTs

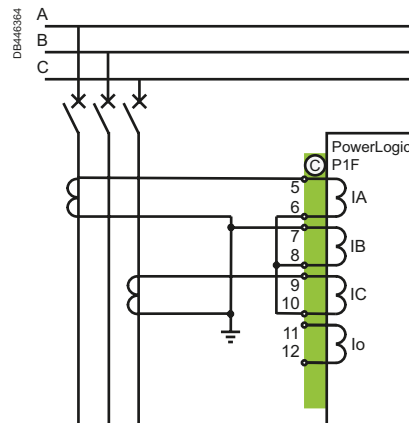
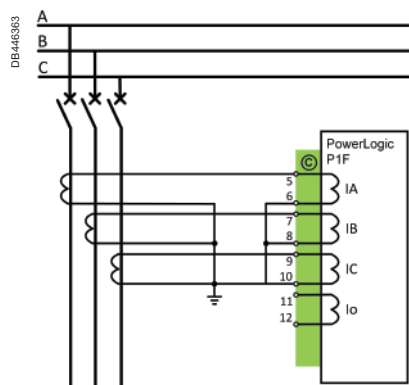


Variant No. 3

Variant No. 4

Typical connection 3 phase CTs, earth fault current measured on the common point of the 3 phase CTs


Typical connection 3 phase CTs, earth fault current measured by core balance CT

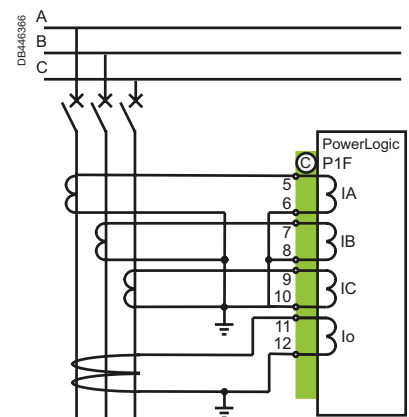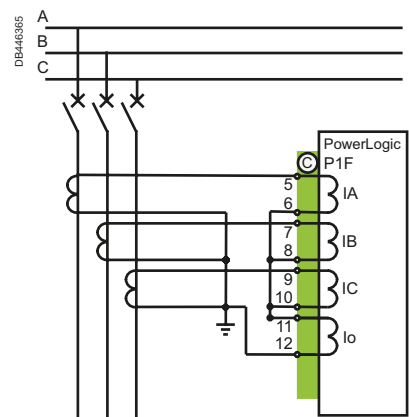

## PowerLogic™ P1F Models: L, N, B, A, E, E+, C, C+


### Variant No. 5

Typical connection 2 phases CTs, earth fault current measured by core balance CT

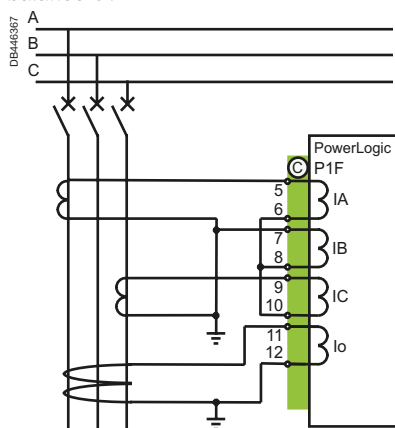

### Variant No. 6


Earth fault current measured by 1 earth CT

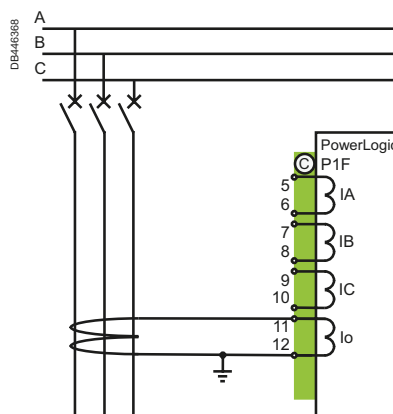


## PowerLogic™ P1F model: E+, T+only

### Variant for Neutral voltage 3Vo from open delta connection

Typical connection 3 phase CTs, earth fault CBCT and neutral voltage

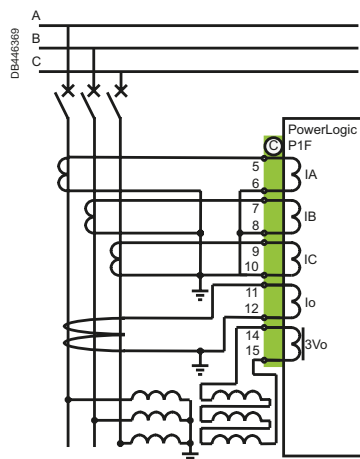

Typical connection 3 phase LPCT, earth fault CBCT and neutral voltage

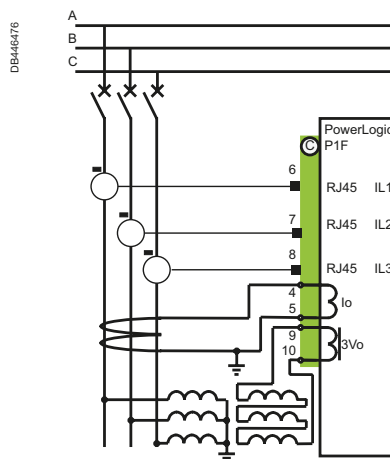

# PowerLogic™ Digital Experience

# PowerLogic™ Digital Experience

<b>PowerLogic™ P1 Software</b>	<b>52</b>
eSetup Easergy Pro Presentation	52
eSetup Easergy Pro Description	53

## Minimum requirements for running eSetup Easergy Pro:

- Windows 7 or higher
- 512 MB RAM
- 50 MB Disk space


## eSetup Easergy Pro

eSetup Easergy Pro offers facilities to set up PowerLogic relays. Intuitive and simple, eSetup Easergy Pro is a user-oriented interface to assist you during the engineering, commissioning and operation of PowerLogic protection relays.

Its streamlined workflow and graphical representations has been designed to smooth your configuration process.

The software is available for download on the Schneider Electric website.

Connect the PC running eSetup Easergy Pro to the USB port of the PowerLogic protection relay during commissioning to adjust the settings and test the relay.

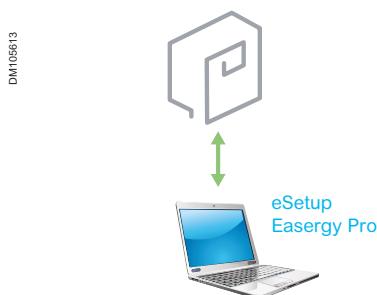

More info and download installation file  
on [www.se.com](http://www.se.com) 

## eSetup Easergy Pro at each step of the digital life







## During Engineering

- Create the configuration of the PowerLogic P1 relay: select the appropriate options and receive the order code
- Set the characteristics of the CTs, VTs connected to the relay, and select the protection functions that will be activated and their settings
- Map the digital inputs of the relay and different internal signals to the relevant functions, LEDs, and digital outputs, using a straightforward matrix format.
- Complete the setting of additional functions (disturbance recorder, event logging system, clock synchronization, etc.).

## During Commissioning

- Connect to the front panel of one single relay
- Open the Digital Inputs menu to check the status of inputs. Reverse the polarity or add a filtering delay if necessary
- Open the Relays menu and force the status change of the output relays in order to check the wiring.

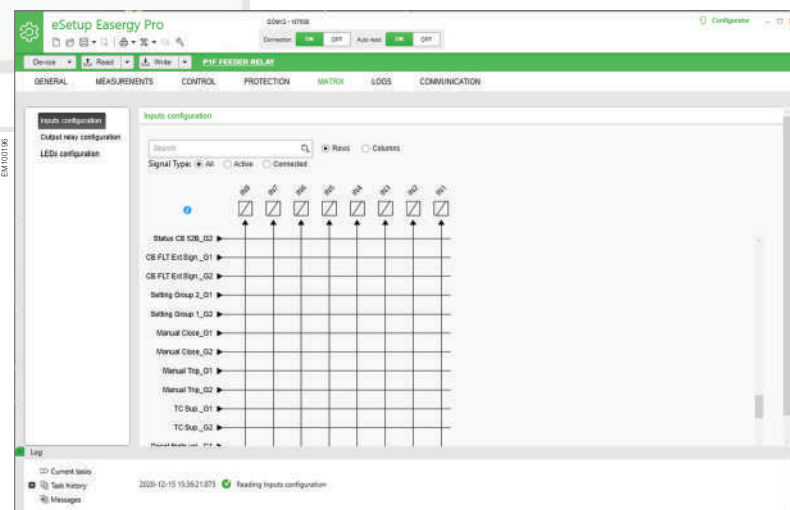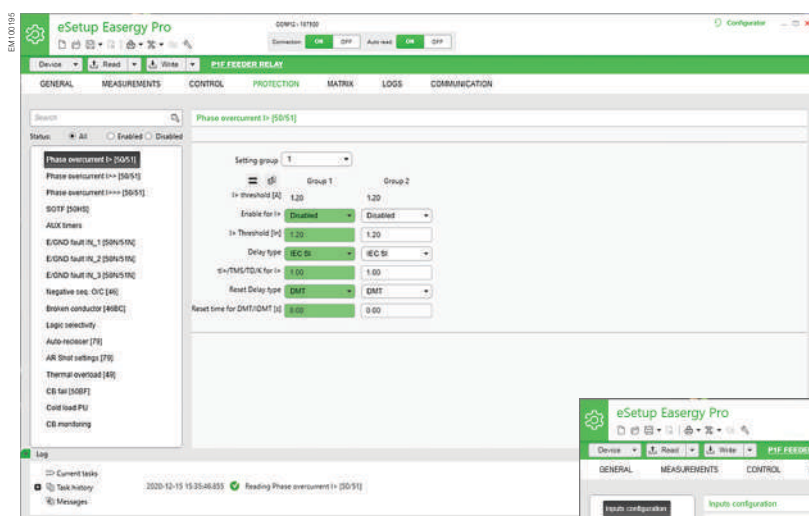

# Schneider Electric Services

# Schneider Electric Services

Greater Peace of Mind Throughout your Installation Lifecycle	56
On-site Condition Maintenance with ProDiag MV Relay	57


# Greater Peace of Mind Throughout your Installation Lifecycle

## How can you reduce costs and improve performance at the same time?

When it comes to your electrical distribution infrastructure, the answer is straightforward: get professional expertise.

### Life cycle services

DM40843

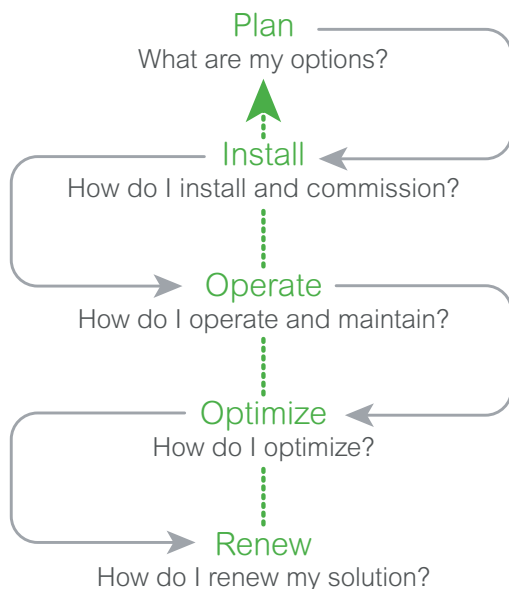

When it comes to your electrical distribution installation, we can help you:

- Increase productivity, reliability, and safety
- Mitigate risk and limit downtime
- Keep equipment up to date and extend lifespan
- Cut cost and increase savings
- Improve your return on investment

**CONTACT US!**

[www.se.com](http://www.se.com)

## Plan

Schneider Electric helps you plan the design and execution of your solution, looking at how to make your process more dependable and optimize time:

- **Technical feasibility studies:** Design solution in your environment.
- **Preliminary design:** Accelerate turnaround time to reach a final solution design.

## Install

Schneider Electric will help you to install more efficient, more reliable and safer solutions based on your plans:

- **Project management:** Complete your projects on time and within budget.
- **Commissioning:** Ensure your actual performance versus design, through on-site testing and commissioning, and tools and procedures.

## Operate

Schneider Electric helps you maximize your installation uptime and control your capital expenditures through its services offering:

- **Asset operation solutions:** Provide the information you need to help: increase safety, enhance installation performance, and optimize asset maintenance and investment.
- **Advantage service plans:** Customize service plans that include preventive, predictive and corrective maintenance.
- **On-site maintenance services:** Deliver extensive knowledge and experience in electrical distribution maintenance.
- **Spare parts management:** Ensure spare parts availability and optimized maintenance budget of your spare parts.
- **Technical training:** Build necessary skills and competencies to properly and safely operate your installations.

## Optimize

Schneider Electric proposes recommendations for improved safety, availability, reliability and quality:

- **MP4 electrical assessment:** Define an improvement and risk management program.

## Renew

We extend the life of your system while providing upgrades and we can even offer to take full responsibility for the end-of-life processing of old electrical equipment:

- **Retrofit:** Keep up to date and improve the performance of electrical installations.
- **MV product end of life:** Recycle and recover outdated equipment with end-of-life services.

# On-site Condition Maintenance with ProDiag MV Relay



## Why Carry Out Diagnostics?

Business competitiveness depends strongly on productivity, and productivity means uptime. On-site condition maintenance, with regular diagnostics, provides a long-term solution to reduce risk of downtime.

### Why Perform PowerLogic™ Relay Diagnostics with Schneider Electric?

Schneider Electric offers a complete range of maintenance services to provide you with the necessary level of maintenance for your PowerLogic devices. Having Schneider Electric at your side means our highly qualified personal can perform the right maintenance, while complying with manufacturer procedures and international services.

## Diagnosing Protection Relay Tripping Capability


The ProDiag MV Relay diagnostic solution should be used on MV protection relays that have not received any diagnostics within the last four years.

This diagnostic checks the protection relay's conformity against the original product specifications verify if that they meet their goals of:

- Reducing risks by isolating hazardous segments of the network where an electrical fault has been detected
- Maintaining energy availability
- Maximizing uptime by performing in-depth analysis and de-energizing equipment only when necessary

### ProDiag MV Relay's Unique Features:

- Automatic download of all protection relay settings through drivers in the ProDiag MV Relay manager
- Easy verification of modifications made to protection settings since the last visit
- Easy verification of MV Relay original technical specifications

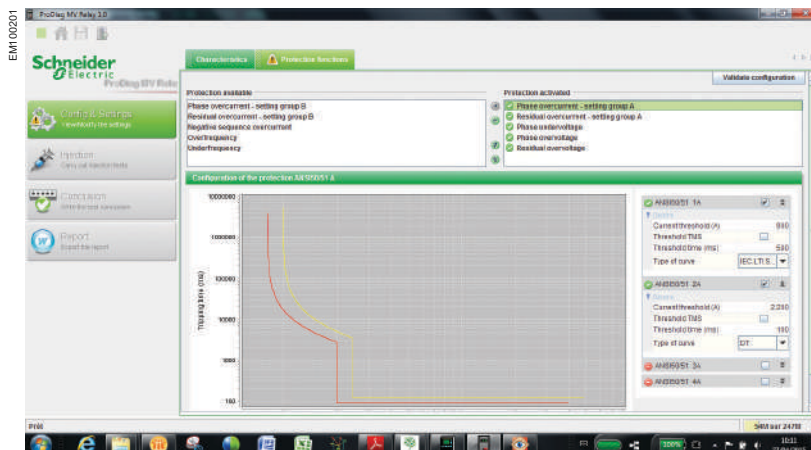

\*PEP: Product Environmental Profile (i.e. Environmental Product Declaration)

# Ordering

# Ordering

<b>Ready-To-Use Configuration</b>	<b>60</b>
PowerLogic™ P1F Ordering Variants	60
PowerLogic™ P1V Ordering Variants	62
<b>Accessories</b>	<b>63</b>

- Please indicate the Part No. (for example: **REL15000**) to your Schneider Electric correspondent
- For other variants please contact your Schneider Electric correspondent

## PowerLogic™ P1F - Feeder protection

Language pack 1: English / German / French / Spanish / Russian / Turkish / Portuguese / Polish

Part No.	Earth CT Input; Oper. Range	Binary inputs voltage	Cortec Code *
<b>Model L: 3 binary outputs + WD, without binary inputs and communication</b>			
REL15000	Ion = 1 A/5 A; 0.01...2 Ion	24...240 Vac/250 Vdc;	P1F1L1N0N92N0NN11N
REL15001	Ion = 1 A/5 A; 0.05...12 Ion	24...240 Vac/250 Vdc;	P1F1L1N3N92N0NN11N
<b>Model L: 3 binary outputs + WD, without binary inputs, rear RS485 port included</b>			
REL15002	Ion = 1 A/5 A; 0.01...2 Ion	24...240 Vac/250 Vdc;	P1F1L1N0N92N1NN11N
REL15003	Ion = 1 A/5 A; 0.05...12 Ion	24...240 Vac/250 Vdc;	P1F1L1N3N92N1NN11N
<b>Model N: 5 binary outputs + WD, without binary inputs, rear RS485 and front USB port</b>			
REL15004	Ion = 1 A/5 A; 0.01...2 Ion	24...240 Vac/250 Vdc;	P1F1N1N0N92N1NN11N
REL15005	Ion = 1 A/5 A; 0.05...12 Ion	24...240 Vac/250 Vdc;	P1F1N1N3N92N1NN11N
<b>Model B: 4 binary inputs; 3 binary outputs + WD, rear RS485 and front USB port including powering</b>			
REL15006	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1B1N0N91N1NN11N
REL15007	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1B1N0N92N1NN11N
REL15008	Ion = 1 A/5 A; 0.05...12 Ion	24...60 Vac/Vdc	P1F1B1N3N91N1NN11N
REL15009	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1B1N3N92N1NN11N
<b>Model A: 4 binary inputs, 7 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder</b>			
REL15010	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1A1N0N91N1NN11N
REL15011	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1A1N0N92N1NN11N
REL15012	Ion = 1 A/5 A; 0.05...12 Ion	24...60 Vac/Vdc	P1F1A1N3N91N1NN11N
REL15013	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1A1N3N92N1NN11N
<b>Model E: 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance rec, auto reclose</b>			
REL15014	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1E1N0N91N1NN11N
REL15015	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1E1N0N92N1NN11N
REL15016	Ion = 1 A/5 A; 0.05...12 Ion	24...60 Vac/Vdc	P1F1E1N3N91N1NN11N
REL15017	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1E1N3N92N1NN11N
<b>Model E+: neutral voltage input, 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder, auto reclose</b>			
REL15020	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1E110N91N1NN11N
REL15021	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1E110N92N1NN11N
REL15022	Ion = 1 A/5 A; 0.05...12 Ion	24...60 Vac/Vdc	P1F1E113N91N1NN11N
REL15023	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1E113N92N1NN11N
<b>Model C: CEI 0-16 compliant, 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder, auto reclose</b>			
REL15054	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1C1N0N91N1NN12N
REL15055	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1C1N0N92N1NN12N

\* Cortec Codes must not be used to order products. Use only RELxxxxxx part number.



- Please indicate the Part No. (for example: **REL15000**) to your Schneider Electric correspondent
- For other variants please contact your Schneider Electric correspondent

### PowerLogic™ P1F - Feeder protection

Language pack 1: English / German / French / Spanish / Russian / Turkish / Portuguese / Polish

Part No.	Earth CT Input; Oper. Range	Binary inputs voltage	Cortec Code *
----------	-----------------------------	-----------------------	---------------

**Model C+:** CEI 0-16 compliant, neutral voltage input, 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder, auto reclose

REL15056	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1C110N91N11N12N
REL15057	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1C110N92N11N12N

**Model T:** CEI 0-16 compliant, LPCT inputs, 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder, auto reclose

REL15050	Ion = 1 A/5 A; 0.01...2 Ion	Vx = 24...60 Vac/Vdc	P1F1T1N0N91N11N12N
REL15051	Ion = 1 A/5 A; 0.01...2 Ion	Vx = 90...240 Vac/250 Vdc	P1F1T1N0N92N11N12N

**Model T+:** CEI 0-16 compliant, LPCT inputs, neutral voltage input, 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder, auto reclose

REL15052	Ion = 1 A/5 A; 0.01...2 Ion	Vx = 24...60 Vac/Vdc	P1F1T110N91N11N12N
REL15053	Ion = 1 A/5 A; 0.01...2 Ion	Vx = 90...240 Vac/250Vdc	P1F1T110N92N11N12N

### PowerLogic™ P1F - Feeder protection - Asia Offer

Language pack 3: English / Chinese Simplified / Korean / Traditional Chinese

Part No.	Earth CT Input; Oper. Range	Binary inputs voltage	Cortec Code *
----------	-----------------------------	-----------------------	---------------

**Model B:** 4 binary inputs; 3 binary outputs + WD, rear RS485 and front USB port including powering

REL15006C	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1B1N0N91N11N31N
REL15007C	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1B1N0N92N11N31N
REL15008C	Ion = 1 A/5 A; 0.05...12 Ion	24...60 Vac/Vdc	P1F1B1N3N91N11N31N
REL15009C	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1B1N3N92N11N31N

**Model E:** 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance rec, auto reclose

REL15014C	Ion = 1 A/5 A; 0.01...2 Ion	24...60 Vac/Vdc	P1F1E1N0N91N11N31N
REL15015C	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1E1N0N92N11N31N
REL15016C	Ion = 1 A/5 A; 0.05...12 Ion	24...60 Vac/Vdc	P1F1E1N3N91N11N31N
REL15017C	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1E1N3N92N11N31N

### PowerLogic™ P1F - Feeder protection - EAC Offer

Language pack 1: English / German / French / Spanish / Russian / Turkish / Portuguese / Polish

Part No.	Earth CT Input; Oper. Range	Binary inputs voltage	Cortec Code *
----------	-----------------------------	-----------------------	---------------

**Model B:** 4 binary inputs; 3 binary outputs + WD, rear RS485 and front USB port including powering

REL15007R	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1B1N0N92N11N11N
REL15009R	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1B1N3N92N11N11N

**Model A:** 4 binary inputs, 7 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder

REL15011R	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1A1N0N92N11N11N
REL15013R	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1A1N3N92N11N11N

**Model E+:** neutral voltage input, 8 binary inputs; 5 binary outputs + WD, rear RS485, front USB with powering, disturbance recorder, auto reclose

REL15021R	Ion = 1 A/5 A; 0.01...2 Ion	90...240 Vac/250 Vdc	P1F1E110N92N11N11N
REL15023R	Ion = 1 A/5 A; 0.05...12 Ion	90...240 Vac/250 Vdc	P1F1E113N92N11N11N

\* Cortec Codes must not be used to order products. Use only RELxxxxxx part number.

- Please indicate the Part No. (for example: **REL15000**) to your Schneider Electric correspondent
- For other variants please contact your Schneider Electric correspondent

### PowerLogic™ P1V - Voltage and Frequency protection

Language pack 1: English / German / French / Spanish / Russian / Turkish / Portuguese / Polish

Part No.	Measuring ranges	Binary inputs voltage	Cortec Code *
----------	------------------	-----------------------	---------------

**Model L:** 3 voltage inputs, 4 binary outputs, without binary inputs and communication

REL15024	Un = 57...130 Vac	24...240 Vac/250 Vdc	P1V1L10N1N2N0NN11N
REL15025	Un = 220...480 Vac	24...240 Vac/250 Vdc	P1V1L10N2N2N0NN11N

**Model N:** 4 voltage inputs, 6 binary outputs, 2 binary inputs, rear RS485 and front USB port with powering, communication protocol switchable between IEC 60870-5-103 or Modbus

REL15026	Un = 57...130 Vac	24...60 Vac/dc	P1V1N11N1N1N1NN11N
REL15027	Un = 220...480 Vac	24...60 Vac/dc	P1V1N11N2N1N1NN11N
REL15028	Un = 57...130 Vac	90...240 Vac/250 Vdc	P1V1N11N1N2N1NN11N
REL15029	Un = 220...480 Vac	90...240 Vac/250 Vdc	P1V1N11N2N2N1NN11N

**Model A:** 4 voltage inputs with frequency protection, 8 binary outputs, 6 binary inputs, rear RS485, front USB port with powering, configuration, and communication protocol switchable between IEC 60870-5-103 or Modbus

REL15030	Un = 57...130 Vac	24...60 Vac/dc	P1V1A11N1N1N1NN11N
REL15031	Un = 220...480 Vac	24...60 Vac/dc	P1V1A11N2N1N1NN11N
REL15032	Un = 57...130 Vac	90...240 Vac/250 Vdc	P1V1A11N1N2N1NN11N
REL15033	Un = 220...480 Vac	90...240 Vac/250 Vdc	P1V1A11N2N2N1NN11N

### PowerLogic™ P1V - Voltage and Frequency protection

Language pack 2: English / Chinese Simplified / Traditional Chinese

Part No.	Measuring ranges	Binary inputs voltage	Cortec Code *
----------	------------------	-----------------------	---------------

**Model A:** 4 voltage inputs with frequency protection, 8 binary outputs, 6 binary inputs, rear RS485, front USB port with powering, configuration, and communication protocol switchable between IEC 60870-5-103 or Modbus

REL15030C	Un = 57...130 Vac	24...60 Vac/dc	P1V1A11N1N1N1NN31N
REL15031C	Un = 220...480 Vac	24...60 Vac/dc	P1V1A11N2N1N1NN31N
REL15032C	Un = 57...130 Vac	90...240 Vac/250 Vdc	P1V1A11N1N2N1NN31N
REL15033C	Un = 220...480 Vac	90...240 Vac/250 Vdc	P1V1A11N2N2N1NN31N

### PowerLogic™ P1V - Voltage and Frequency (EAC - Certification)

Language pack 1: English / German / French / Spanish / Russian / Turkish / Portuguese / Polish

Part No.	Measuring ranges	Binary inputs voltage	Cortec Code *
----------	------------------	-----------------------	---------------

**Model L:** 3 voltage inputs, 4 binary outputs, without binary inputs and communication

REL15024R	Un = 57...130 Vac	24...240 Vac/250 Vdc	P1V1L10N1N2N0NN11E
-----------	-------------------	----------------------	--------------------





**Model N:** 4 voltage inputs, 6 binary outputs, 2 binary inputs, rear RS485 and front USB port with powering, communication protocol switchable between IEC 60870-5-103 or Modbus

REL15028R	Un = 57...130 Vac	90...240 Vac/250 Vdc	P1V1L10N1N2N0NN11E
-----------	-------------------	----------------------	--------------------

**Model A:** 4 voltage inputs with frequency protection, 8 binary outputs, 6 binary inputs, rear RS485, front USB port with powering, configuration, communication protocol switchable between IEC 60870-5-103 or Modbus.

REL15032R	Un = 57...130 Vac	90...240 Vac/250 Vdc	P1V1A11N1N2N1NN11E
-----------	-------------------	----------------------	--------------------

\* Cortec Codes must not be used to order products. Use only RELxxxxxx part number.

PowerLogic™ P1 - Accessories		
Part No.	Designation	
REL15039	Wall mounting adaptor for PowerLogic P1	
REL15040	Front cover for PowerLogic P1	
REL15041	Mounting spring clips for PowerLogic P1 (Supplied with the relay)	
REL15042	Mounting screw clamps for PowerLogic P1	

## www.se.com

This international web site allows you to access all the Schneider Electric solutions and product information via:

- Comprehensive descriptions
- Range datasheets
- A download area
- Product selectors


You can also access information dedicated to your business and contact your Schneider Electric country support.

## Web Selector

This site allows you to access the Schneider Electric products in just two clicks via a comprehensive range of datasheets, with direct links to:

- Complete libraries: technical documents, catalogs, FAQs, brochures
- Selection guides from the e-catalog
- Product discovery sites and their animations

You will also find illustrated overviews, news to which you can subscribe, and a list of country contacts

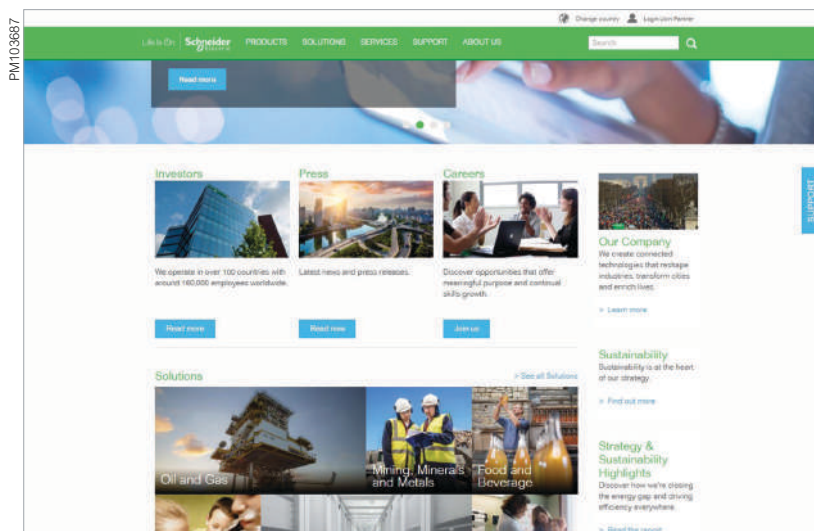

## Training

Training allows you to acquire the expertise (installation design, work with power on, etc.) to increase efficiency and improve customer service.

The training catalog includes beginner's courses in electrical distribution, knowledge of MV and LV switchgear, operation and maintenance of installations, and design of LV installations to give a few examples.





[www.se.com](http://www.se.com)

Schneider Electric Industries SAS  
35, Rue Joseph Monier  
CS 30323  
92506 Rueil Malmaison Cedex

RCS Nanterre 954 503 439  
Capital social 928 298 512 €  
[www.se.com](http://www.se.com)

November 2024  
PowerLogic™ P1

**NRJCAT18818EN**

© 2024 - Schneider Electric. All rights reserved.  
All trademarks are owned by Schneider Electric  
Industries SAS or its affiliated companies.

As standards, specifications and designs develop from time to time, please  
ask for confirmation of the information given in this document.